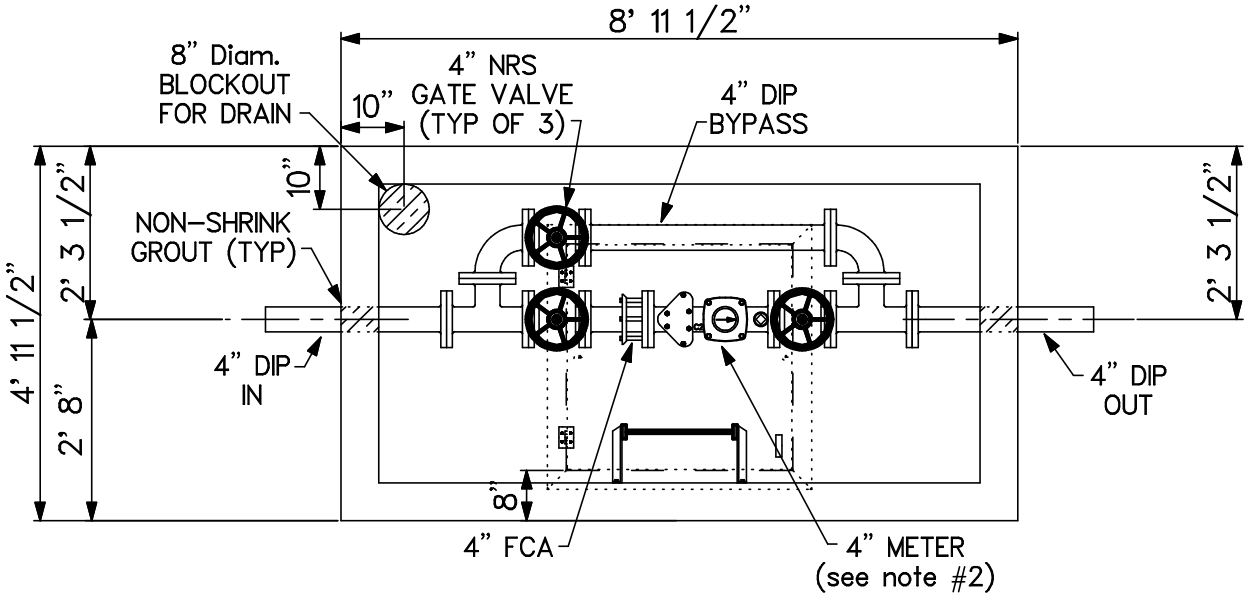

PLAN VIEW

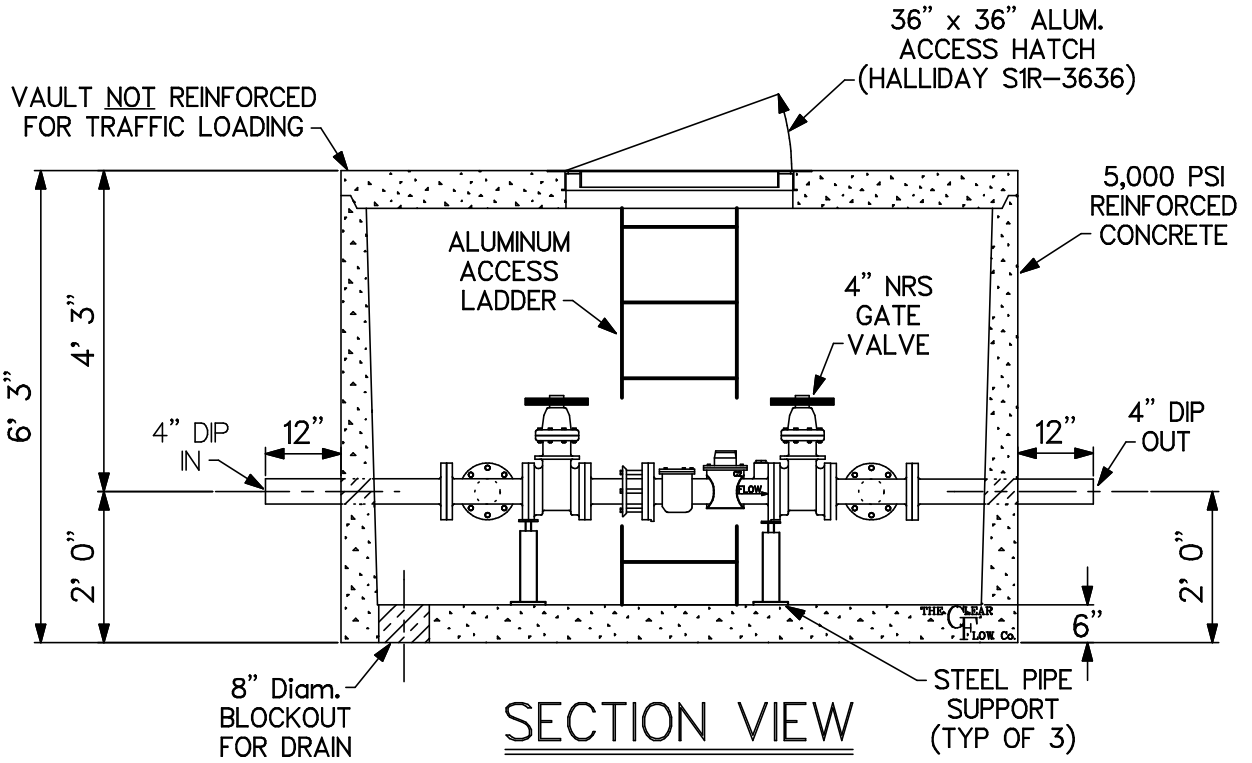

SECTION VIEW

NOTES:

1. VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 18,000 LBS.
2. 4" SENSUS OMNI C2 COMPOUND METER w/INTEGRAL STRAINER

DESIGN		
DRAWN	STEVEN L. GORDON	
REVISIONS		DATE

* PRINTOUT NOT TO ANY SCALE *

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
210 STONE SPRING ROAD
HARRISONBURG, VA 22801
(540) 434 - 6979

REF. NO. MTR4-1000

4" WATER METER VAULT (TJ-1000)

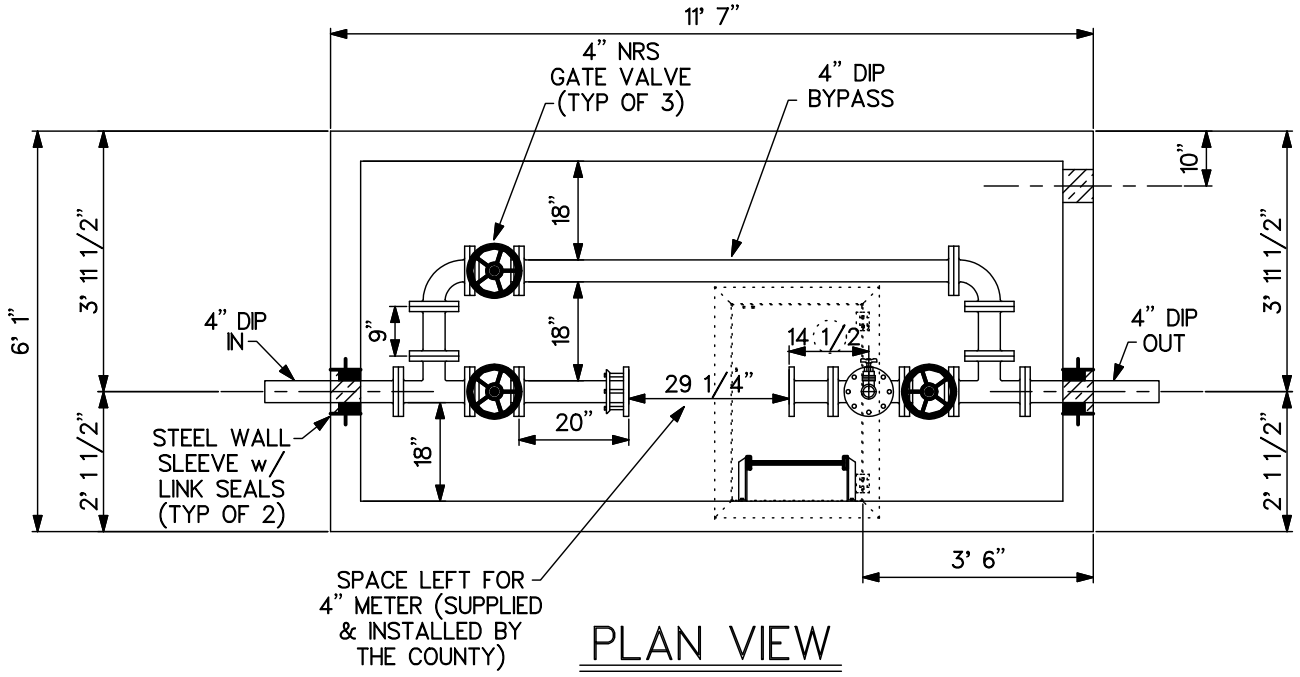

PLAN VIEW

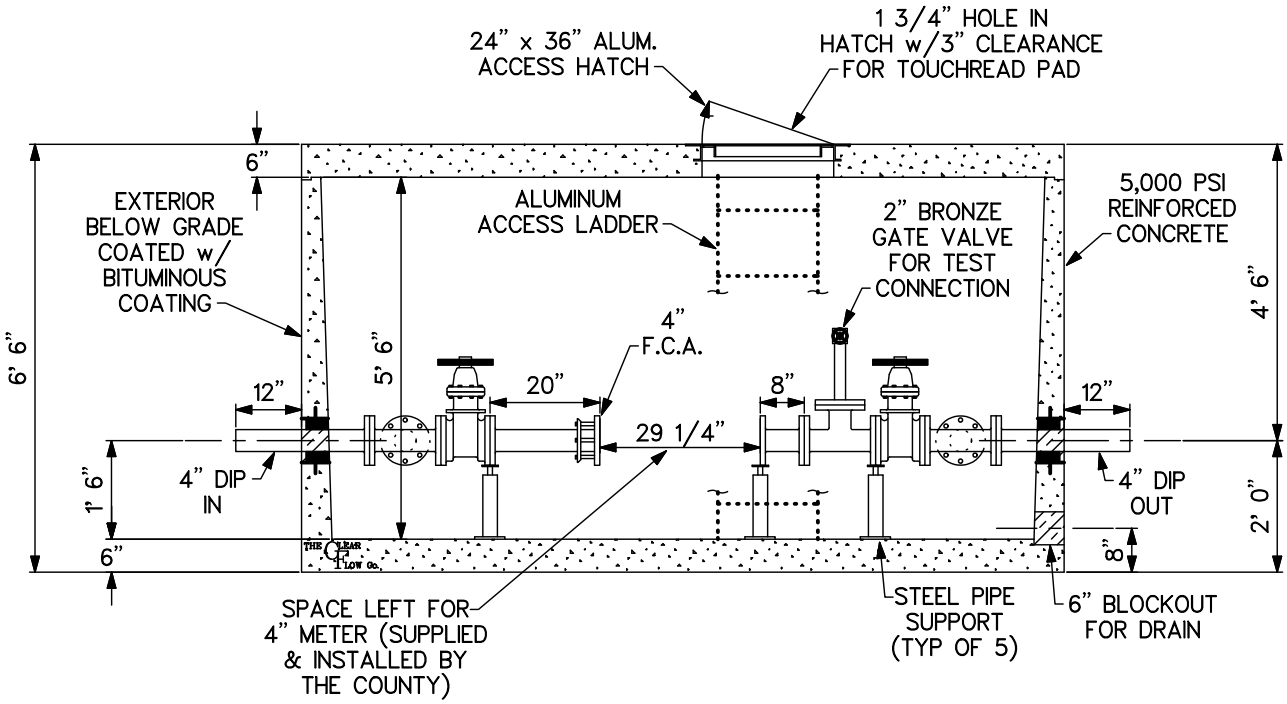

SECTION VIEW

NOTES:

1. CLEAR FLOW METER VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 25,000 LBS. VAULT MUST BE SET WITH CONTRACTOR SUPPLIED CRANE.
2. 29 1/4" SPACE LEFT FOR METER TO BE SUPPLIED AND INSTALLED BY OTHERS. IF DIFFERENT SPACING IS REQUIRED NOTIFY CLEAR FLOW PRIOR TO PRODUCTION.

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 – 2678

SCALE: NONE	DATE: 1/16/08	DWG: MTR4–ALBEMARLE CO

4" WATER METER VAULT (ALBEMARLE COUNTY STANDARD)

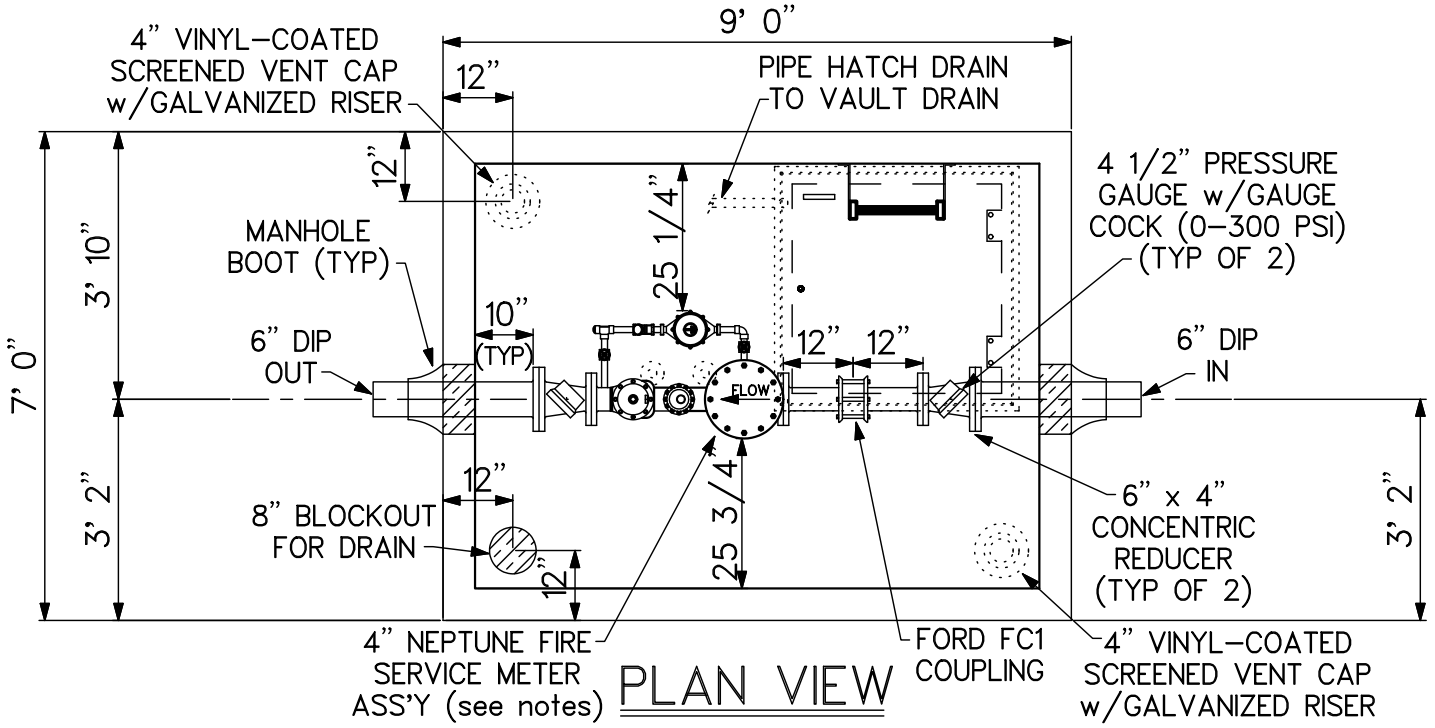

PLAN VIEW

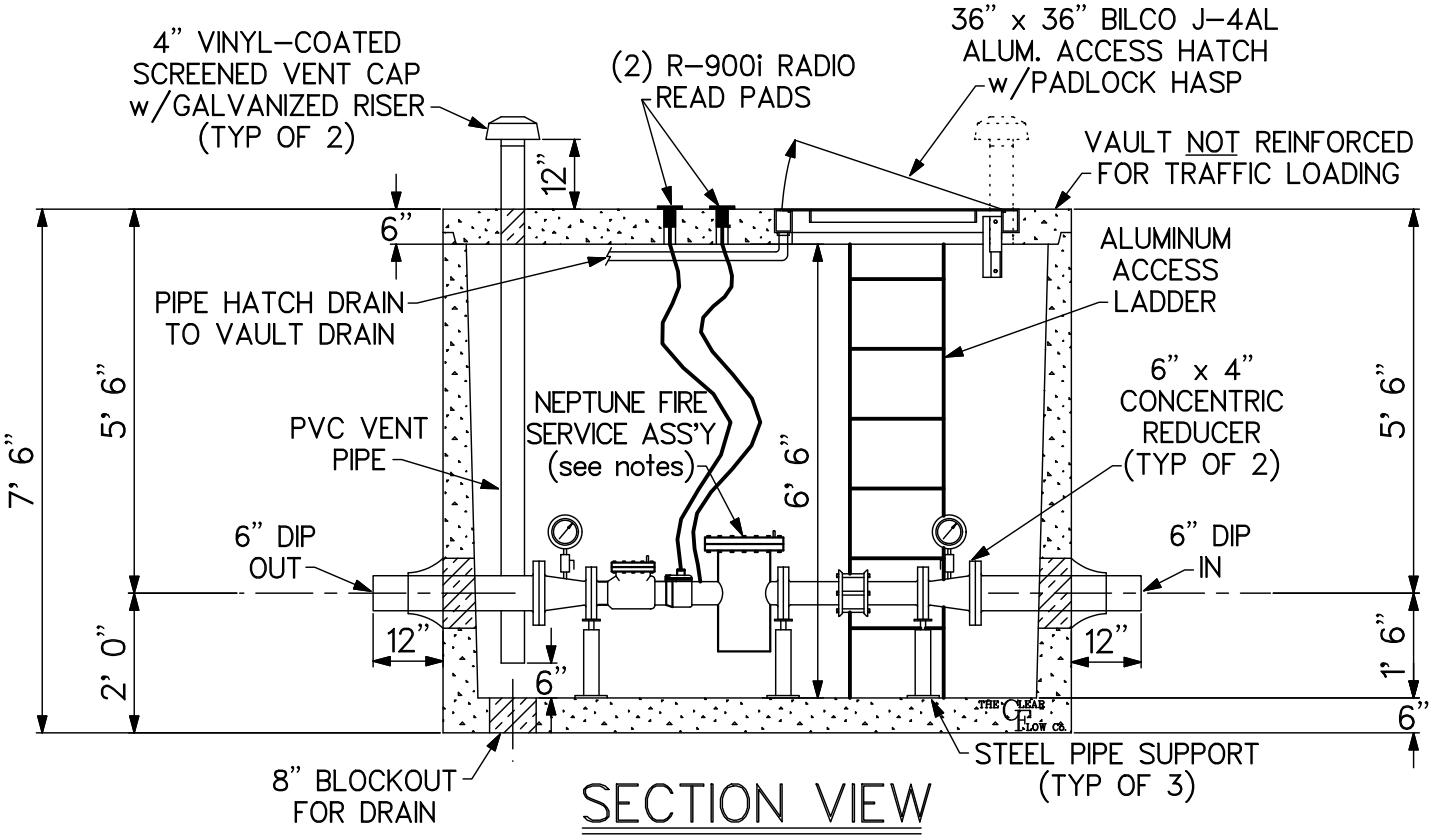

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 24,000 LBS.
2. 4" NEPTUNE HP PROTECTUS III F.S. METER ASSEMBLY w/BYPASS METER & R-900i RADIO READ PADS (GALLONS REGISTER)
3. (2) 4 1/2" ASHCROFT #1082 PRESSURE GAUGE (0-300 PSI) w/GAUGE COCK

CLEAR FLOW BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 8/14/12	DWG: MTR4-BEDFORD CO

4" FIRE FLOW METER VAULT (BEDFORD COUNTY STANDARD)

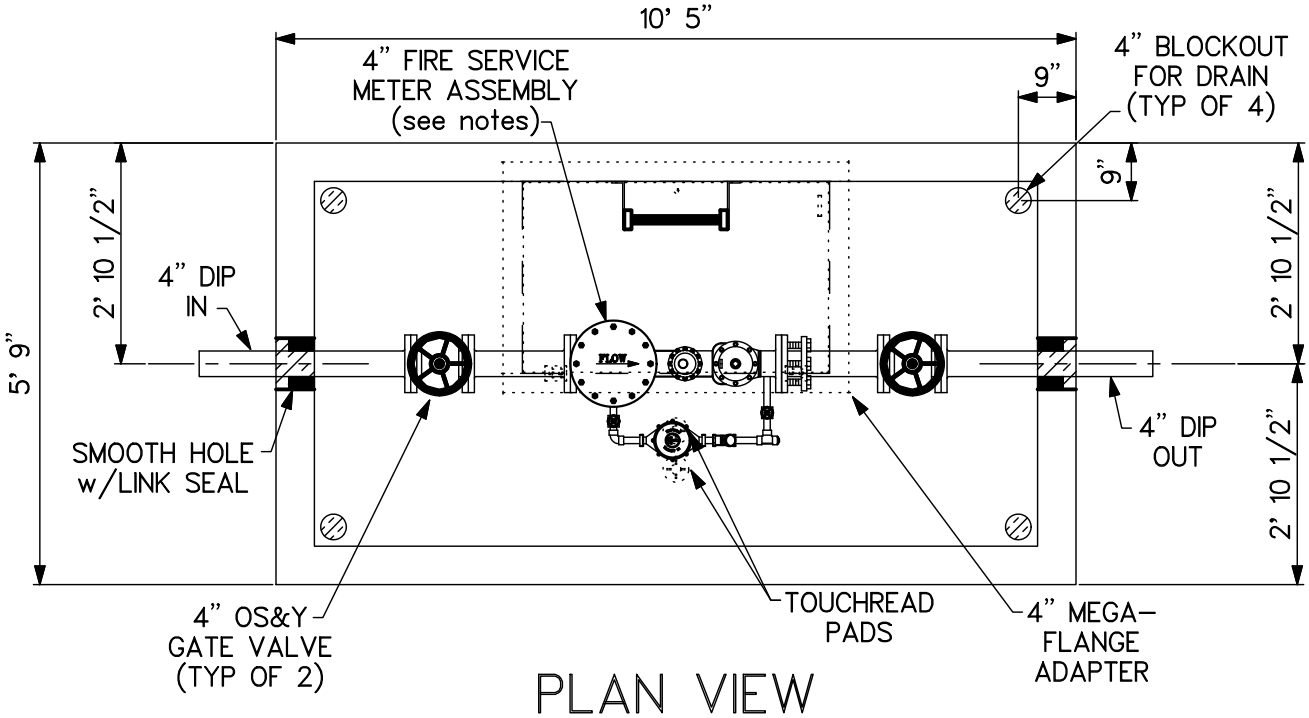

PLAN VIEW

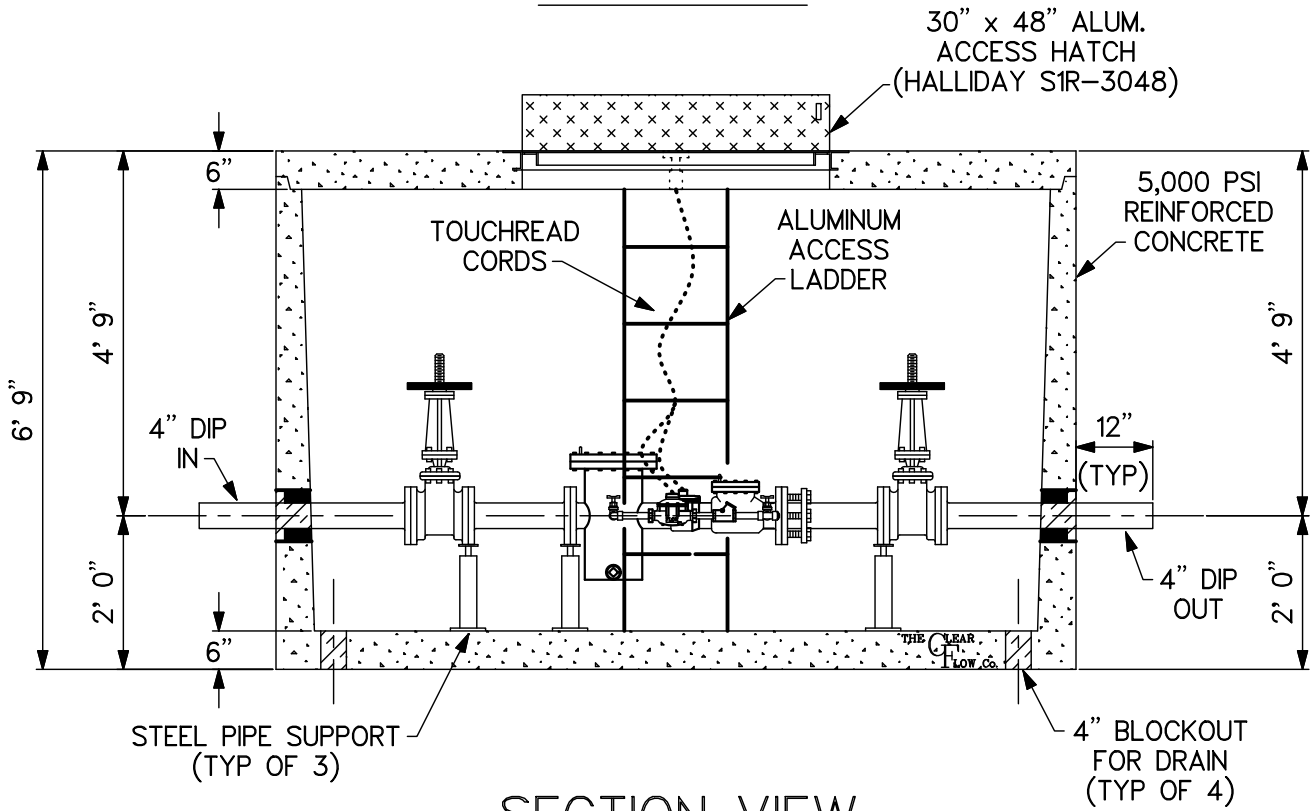

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 21,000 LBS.
2. 4" NEPTUNE PROTECTUS III FIRE SERVICE METER ASSEMBLY w/PRO-READ
3. VAULT IS ALSO AVAILABLE REINFORCED FOR H-20 TRAFFIC LOAD RATING

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 2007	DWG: MTR-FM-TJ-1600

4" FIRE FLOW MASTER METER VAULT

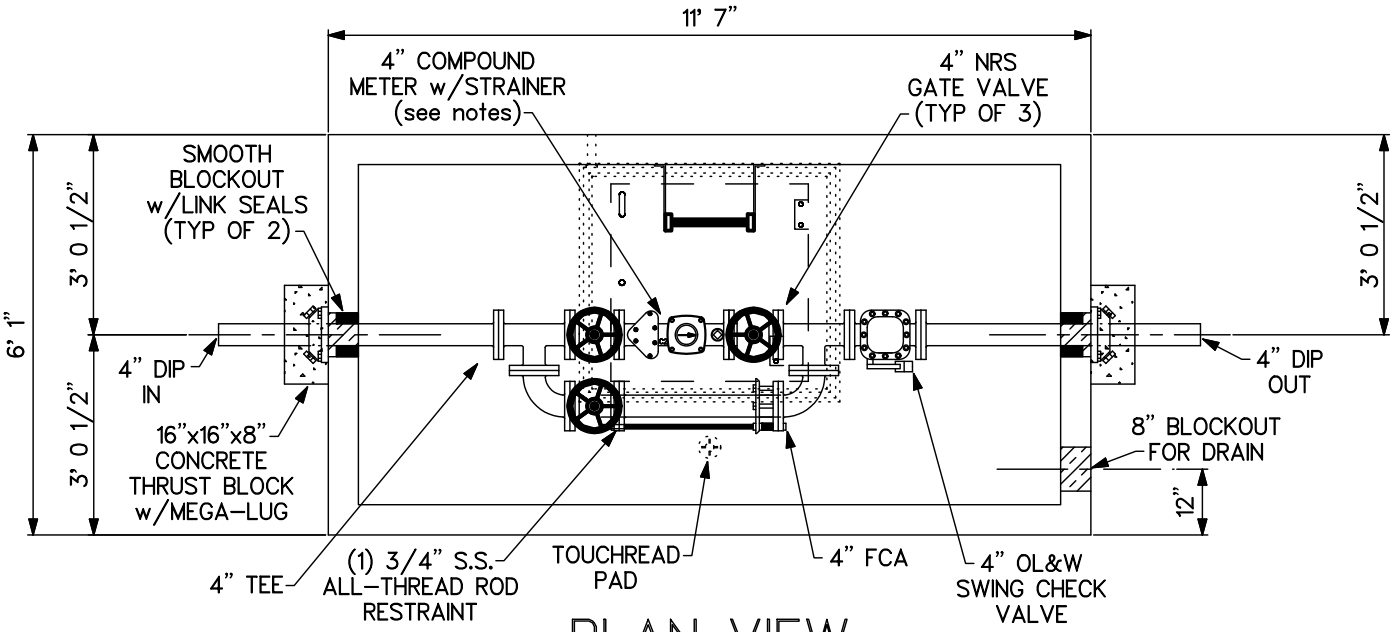

PLAN VIEW

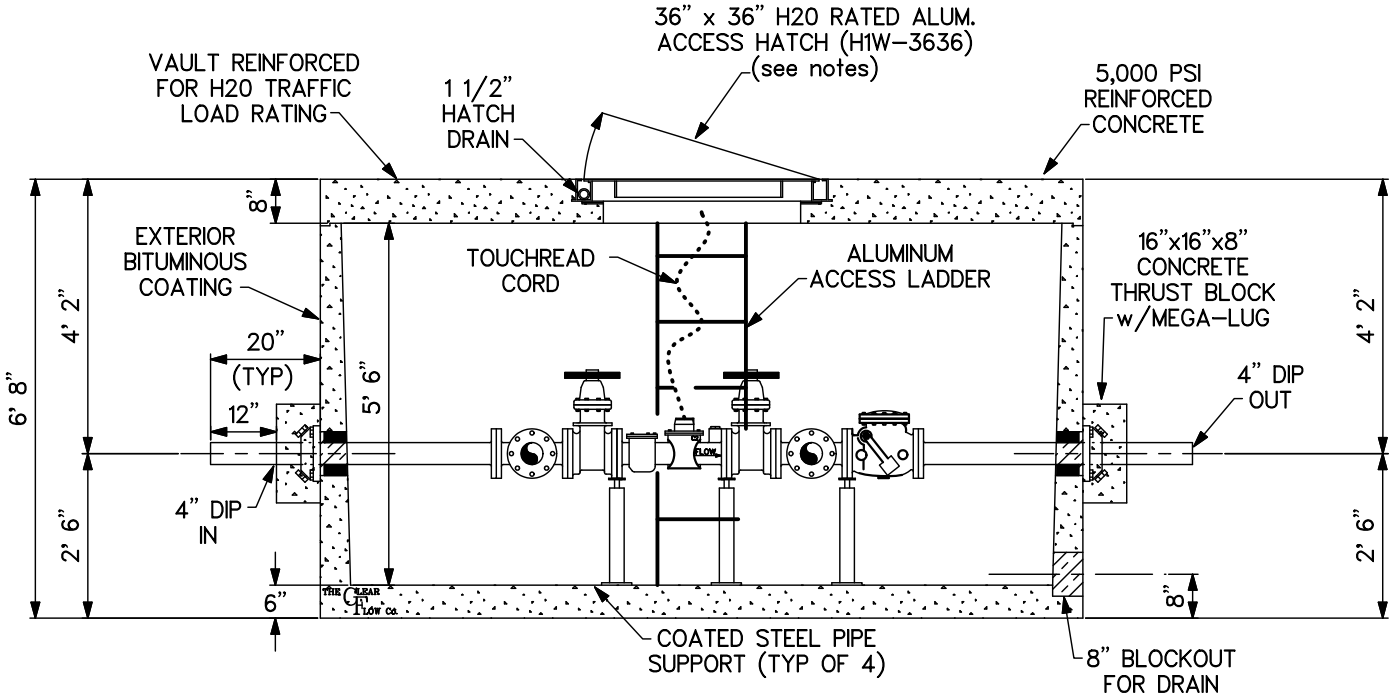

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 25,000 LBS.
2. 4" SENSUS C2 COMPOUND METER w/ INTEGRAL STRAINER w/TOUCHREAD (GALLONS)
3. 4" AMERICAN-DARLING MODEL #50-SC OUTSIDE LEVER & WEIGHT SWING CHECK VALVE
4. ALUMINUM ACCESS HATCHES ARE DESIGNED FOR OFF-STREET USE IN LOW-DENSITY TRAFFIC AREAS ONLY

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 2007	DWG: MTR4-HARRISONBURG-TJ2000

4" COMPOUND METER VAULT (CITY OF HARRISONBURG STANDARD)

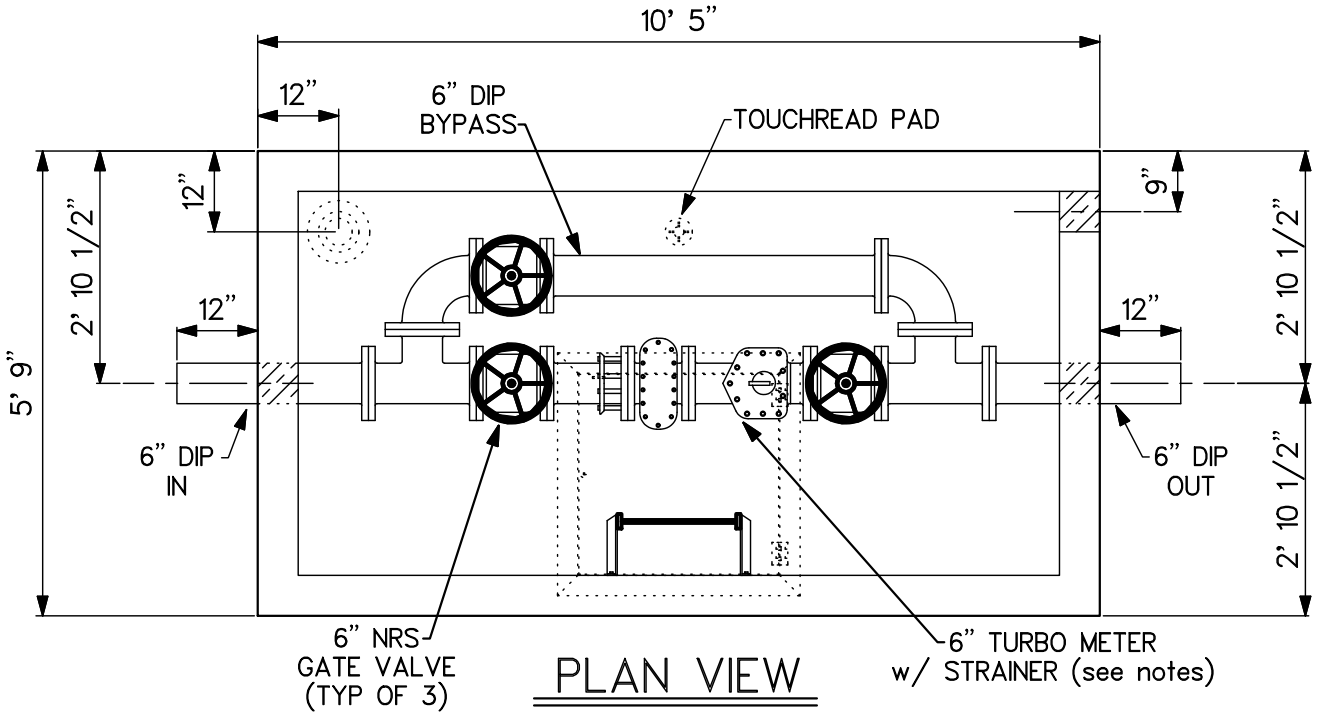

PLAN VIEW

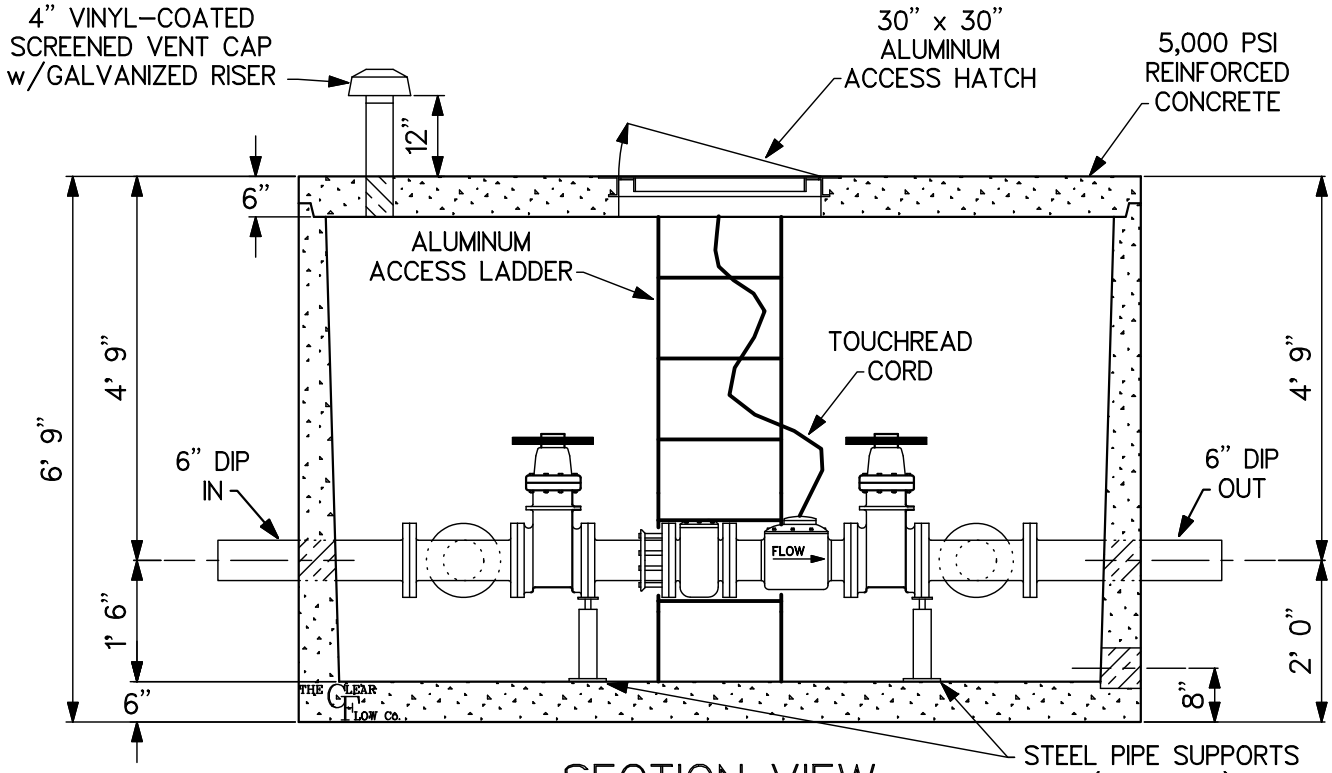

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 21,000 LBS.
2. 6" TURBO METER w/PLATE STRAINER

CLEAR FLOW BY CP&P CONCRETE PIPE & PRECAST, LLC (800) 648 - 2678	SCALE: NONE DATE: 7/08/98 DWG: MTR6-1600	
	6" METER VAULT (TJ-1600 STRUCTURE)	

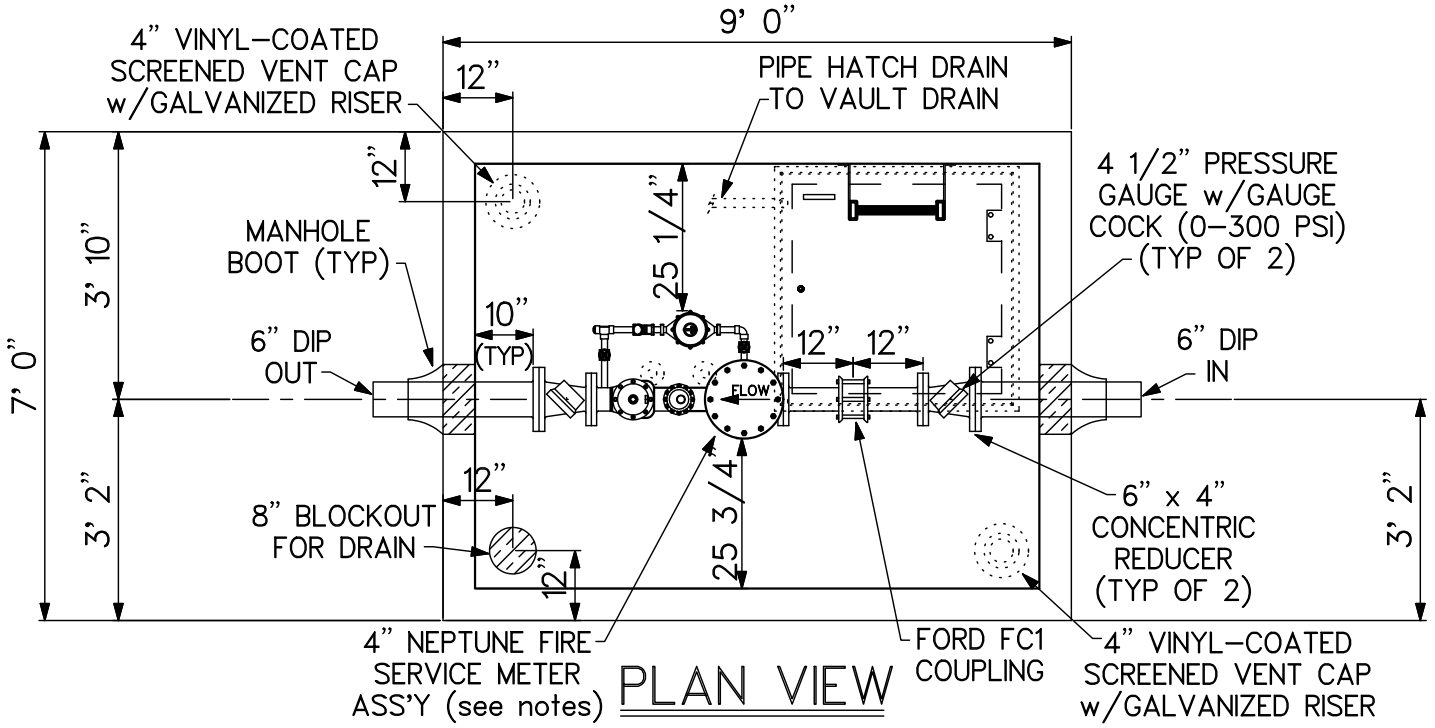

PLAN VIEW

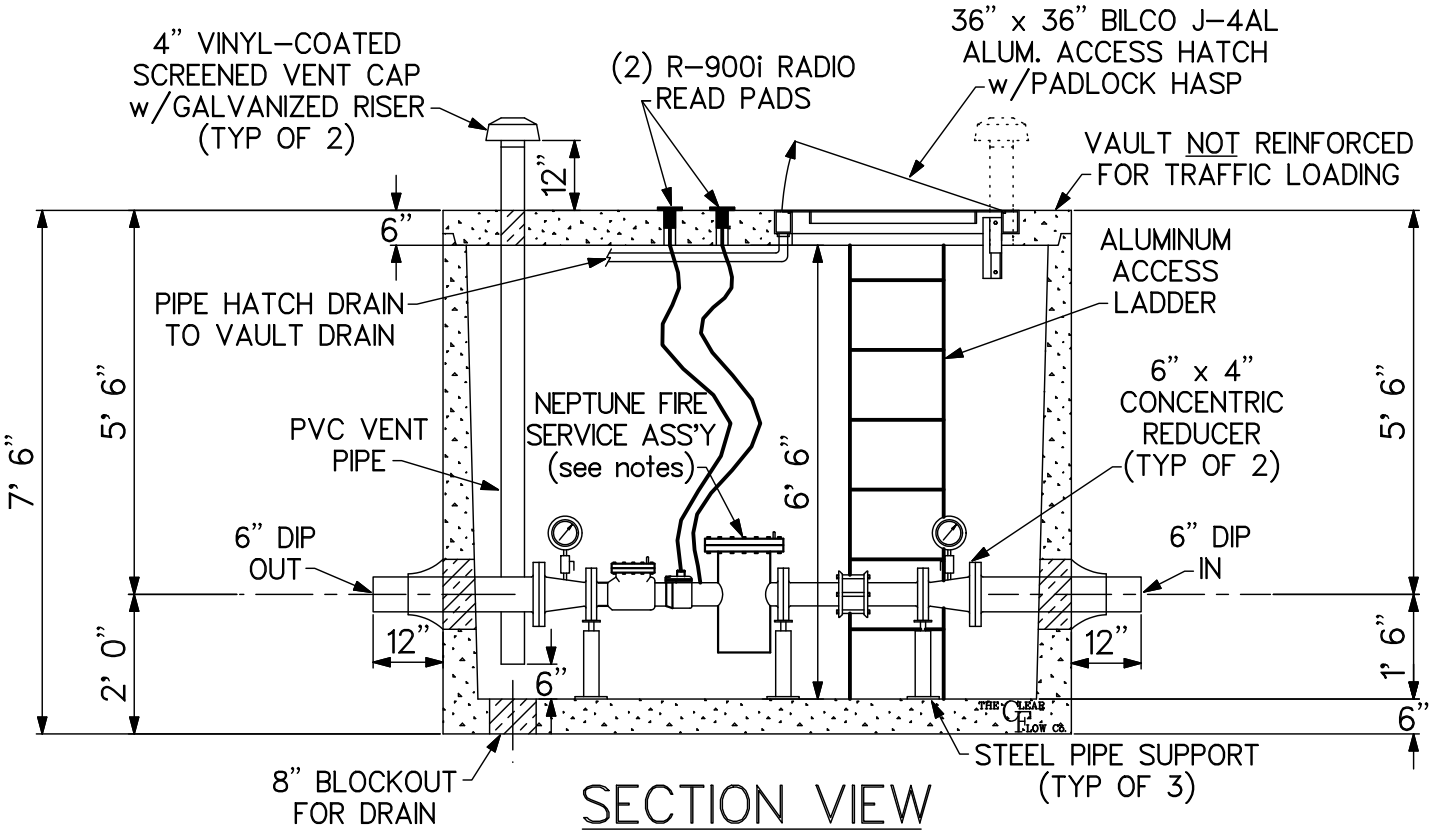

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 24,000 LBS.
2. 4" NEPTUNE HP PROTECTUS III F.S. METER ASSEMBLY w/BYPASS METER & R-900i RADIO READ PADS (GALLONS REGISTER)
3. (2) 4 1/2" ASHCROFT #1082 PRESSURE GAUGE (0-300 PSI) w/GAUGE COCK

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 3/16/07	DWG: MTR6-BEDFORD CO

6" FIRE FLOW METER VAULT (BEDFORD COUNTY STANDARD)

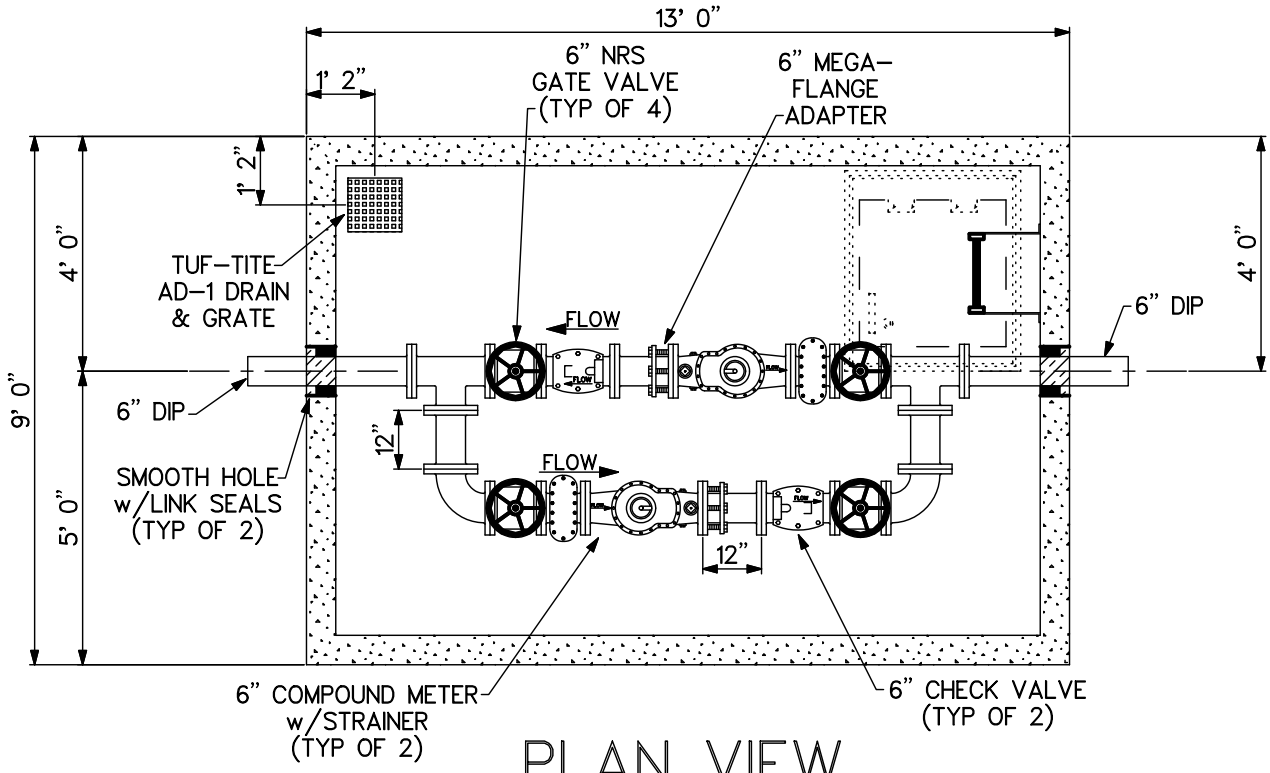

PLAN VIEW

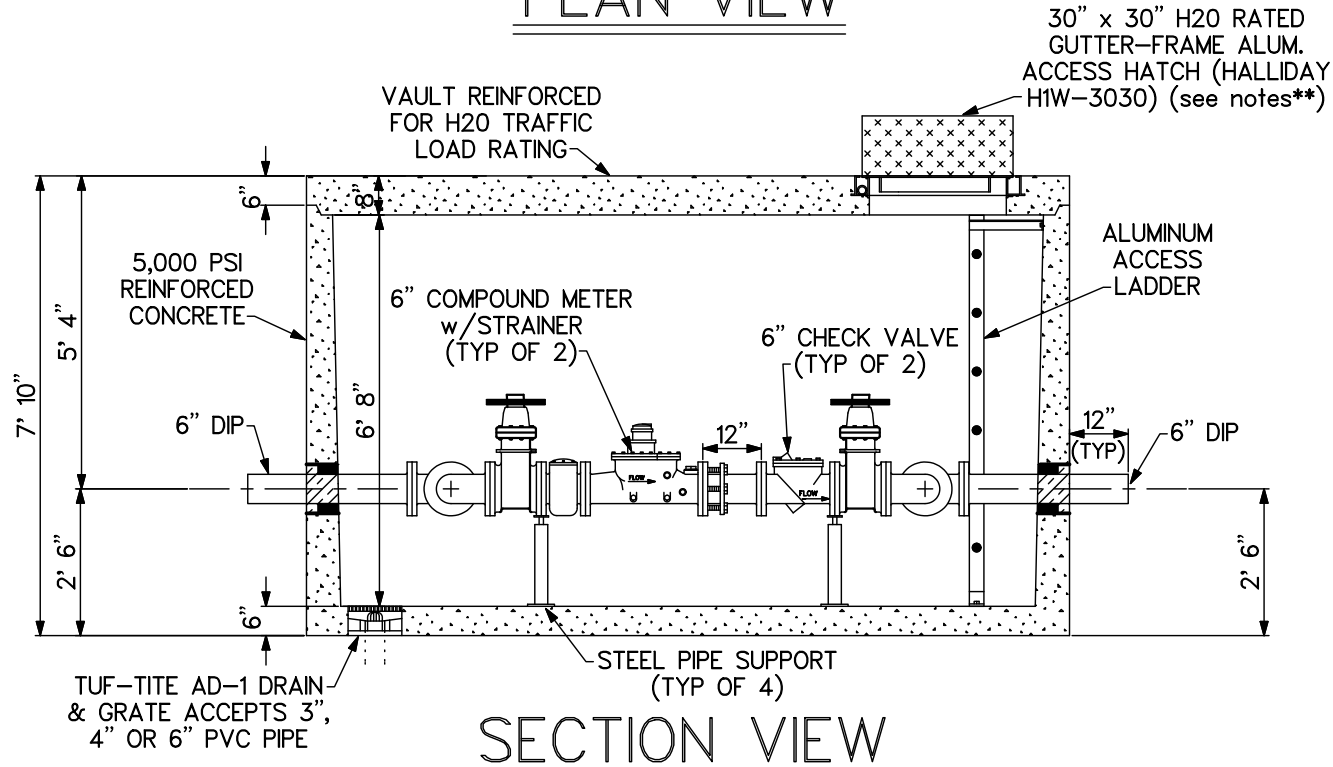

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 44,000 LBS.
2. 6" SENSUS COMPOUND METERS w/STRAINERS & TOUCH-READ (GALLONS)
3. 6" CAL-VAL FLEX CHECK VALVES
4. ALUMINUM ACCESS HATCHES ARE SUITABLE FOR TRAFFIC LOADING IN OFF-STREET LOCATIONS OF LOW-DENSITY TRAFFIC ONLY.

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE:	DWG: MTR6-TWO-WAY FLOW-4K

6" TWO-WAY FLOW METER VAULT

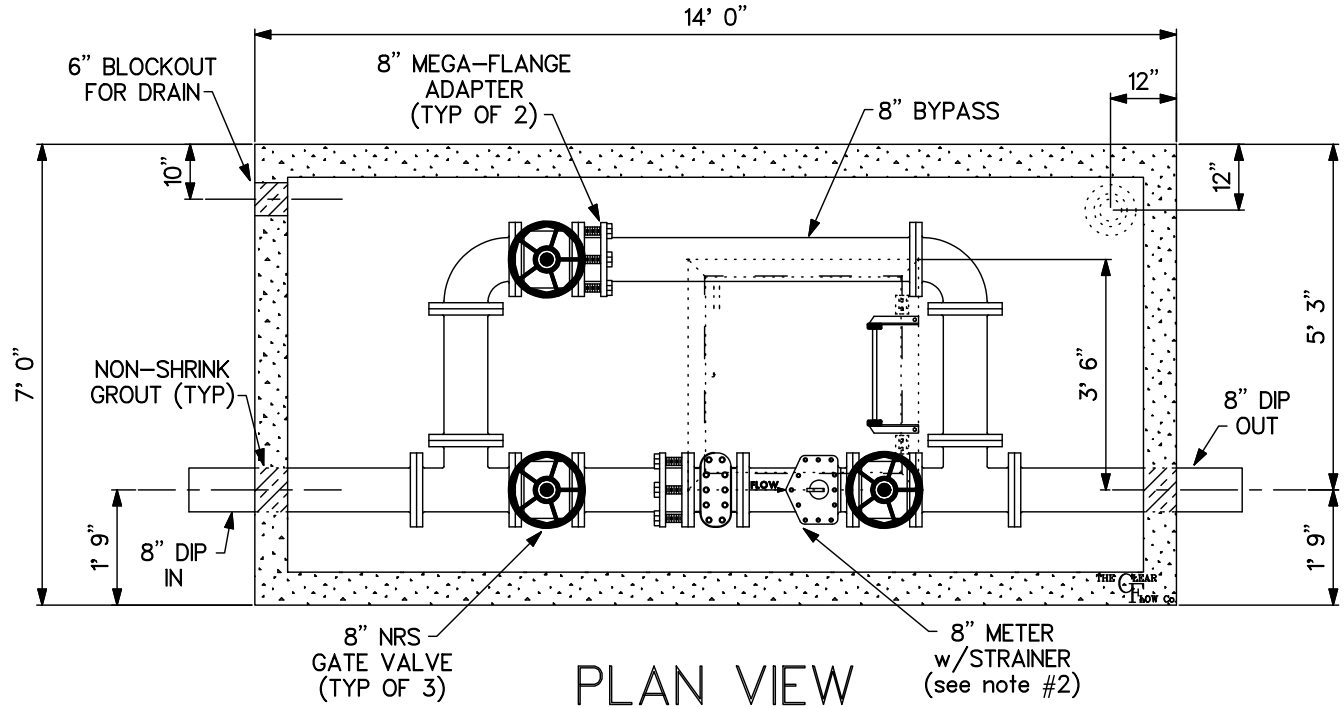

PLAN VIEW

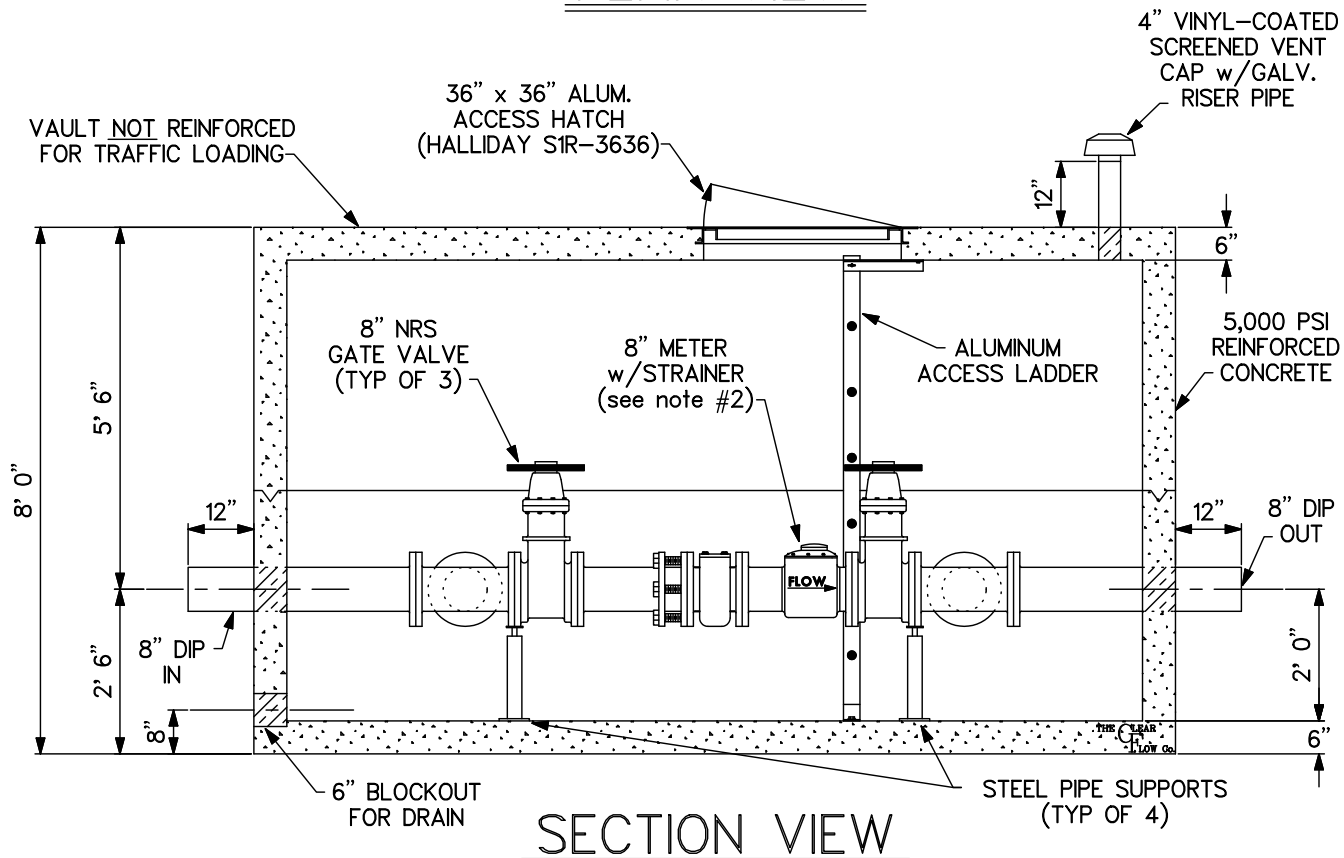

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 38,000 LBS.
2. 8" SENSUS MODEL W-3500 DR TURBO METER w/PLATE STRAINER

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 6/14/06	DWG: MTR8-3500

8" MASTER METER VAULT (613 STRUCTURE)

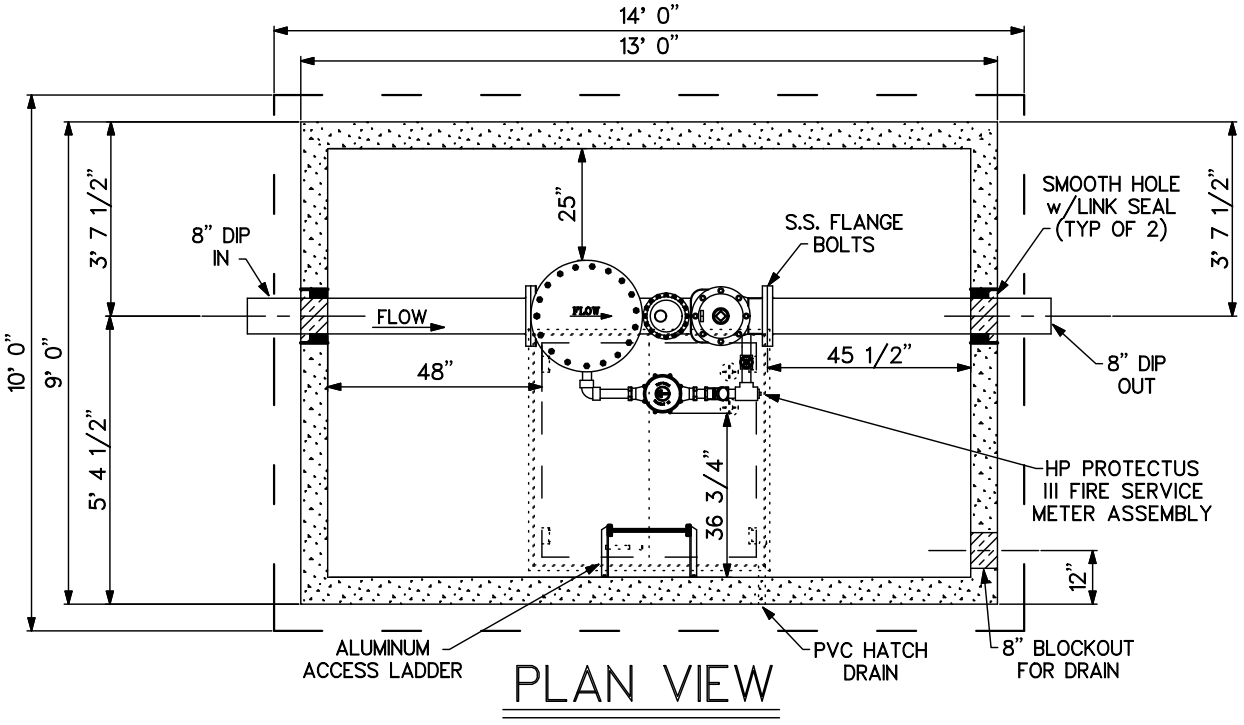

PLAN VIEW

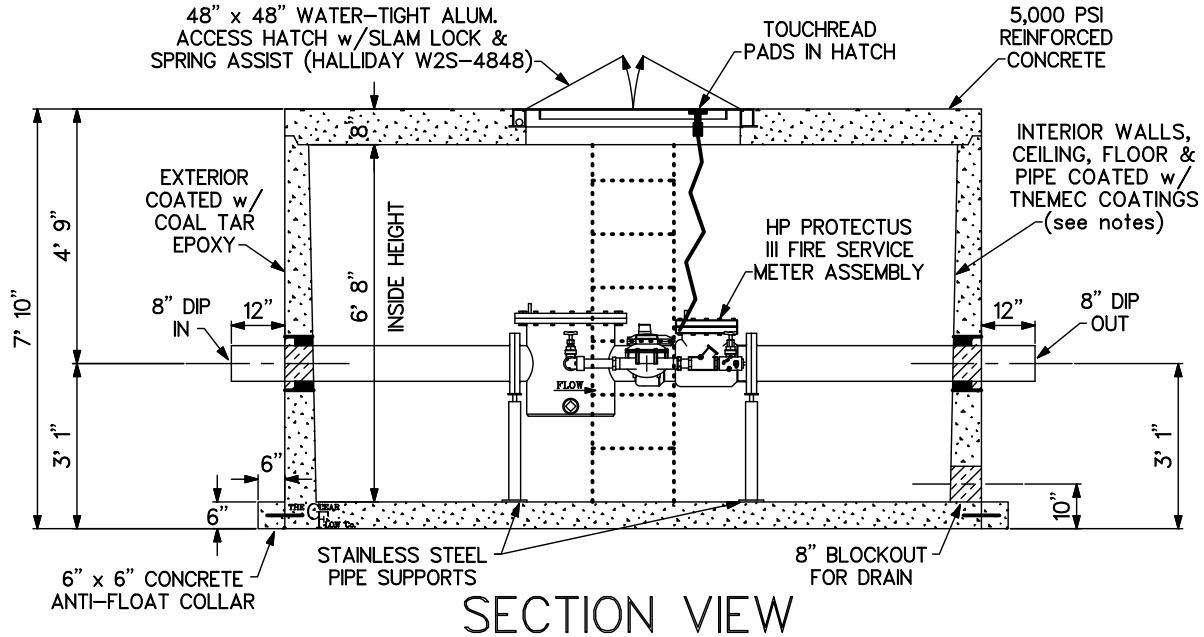

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 44,000 LBS.
2. 8" HP PROTECTUS III FIRE SERVICE METER ASSEMBLY w/2" METERED BYPASS & PRO-READ (METER ASSEMBLY FLANGE BOLTS ARE AS SUPPLIED FROM THE FACTORY)
3. COATING SCHEDULE:
   PIPE & FITTINGS (EXCEPT BRASS OR S.S.) - PRIME COAT - TNEMEC EPOXY #135 - WHITE
   INTERMEDIATE COAT - TNEMEC EPOXY #27 - ALUMINUM
   FINISH COAT - TNEMEC ACRYLIC POLYURETHANE #1074 - BK33 GRAY ANSI No. 61

** FLANGE BOLTS TO BE S.S. AND COATED WITH THE PIPING AFTER ASSEMBLY
   VAULT EXTERIOR (BELOW GRADE) - TNEMEC COAL TAR EPOXY # 46H-413 - BLACK
   VAULT INTERIOR - WALLS & CEILING - PRIME COAT - TNEMEC ACYLIC FILLER #130-6602 - OFF-WHITE
   INTERMEDIATE COAT - TNEMEC ACRYLIC EPOXY #113 - AL82 WARM SUN
   FINISH COAT - TNEMEC ACRYLIC EPOXY #114 H.B. - WH02 TANK WHITE
   VAULT FLOOR - TWO (2) COATS - TNEMEC ACRYLIC POLYAMINE EPOXY #201

CLEAR FLOW BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 2007	DWG: MTR8-FM-JAMESCITYCO

8" MASTER METER VAULT (JAMES CITY COUNTY STANDARD)

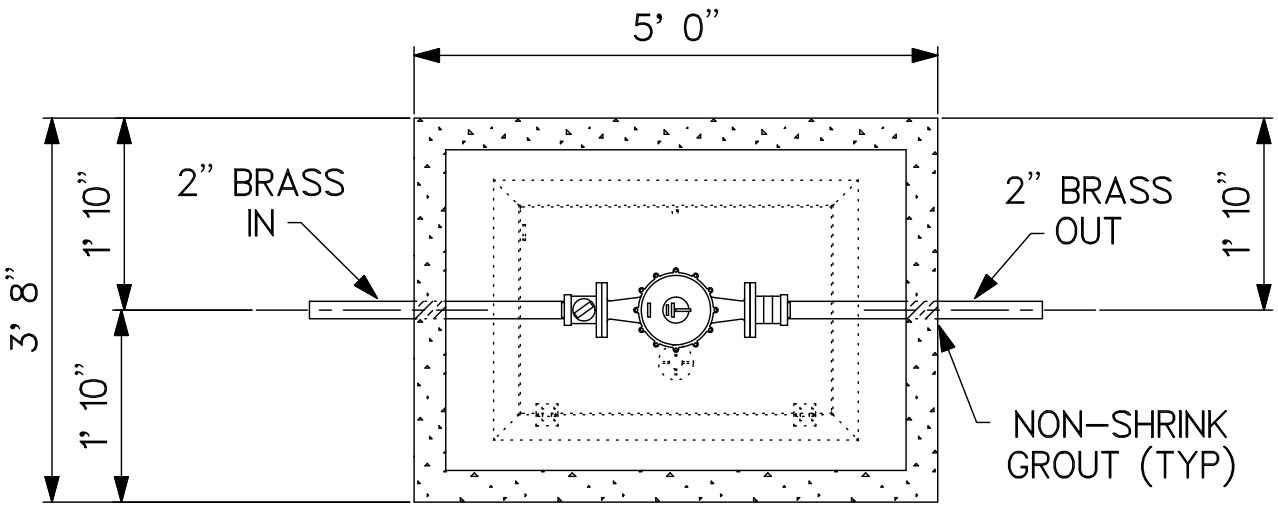

PLAN VIEW

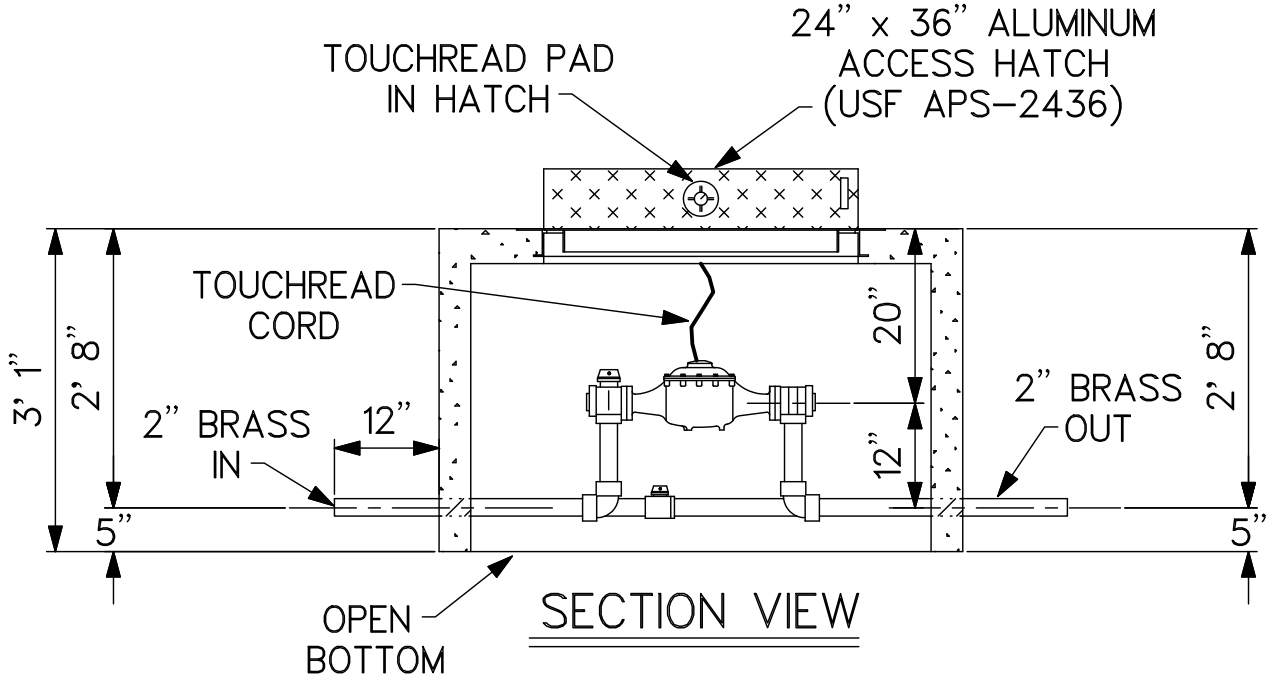

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 3,000 LBS.
2. 2" FORD COPPERSETTER MODEL # VBHH77-12B-11-77 (BALL VALVE INLET, DUAL CHECK OUTLET & BYPASS)
3. 2" SENSUS SR METER w/TOUCHREAD

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 7/11/05	DWG: MTR2-3652

2" METER VAULT (3652 STRUCTURE)

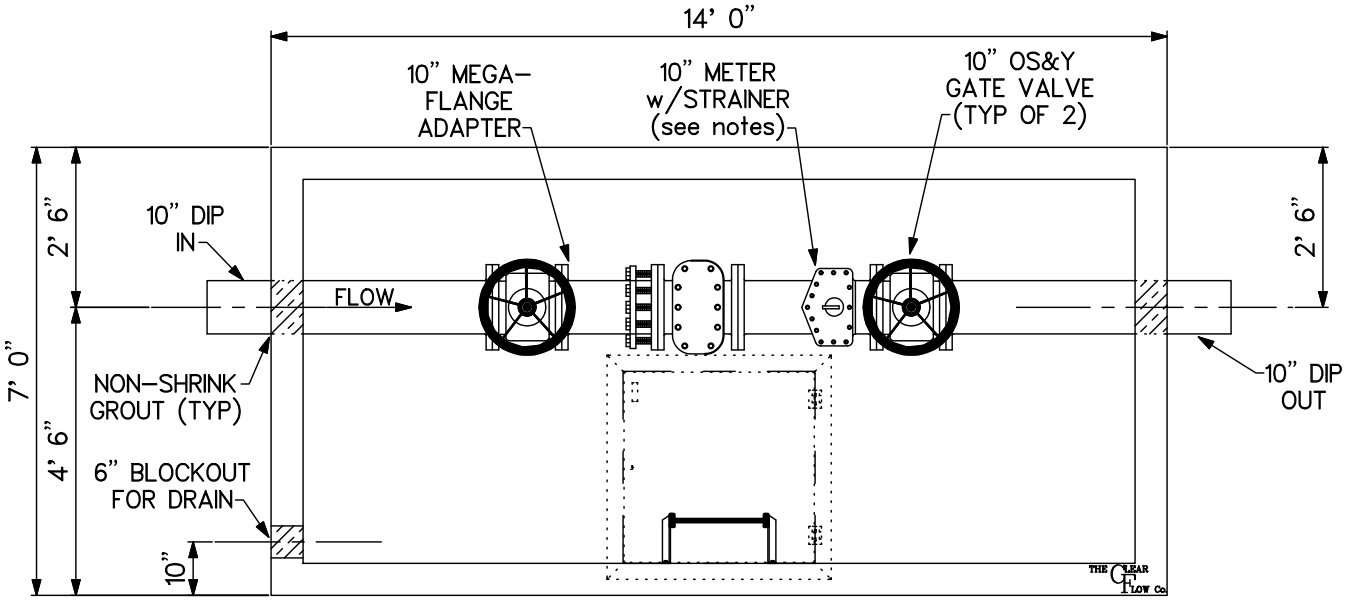

PLAN VIEW

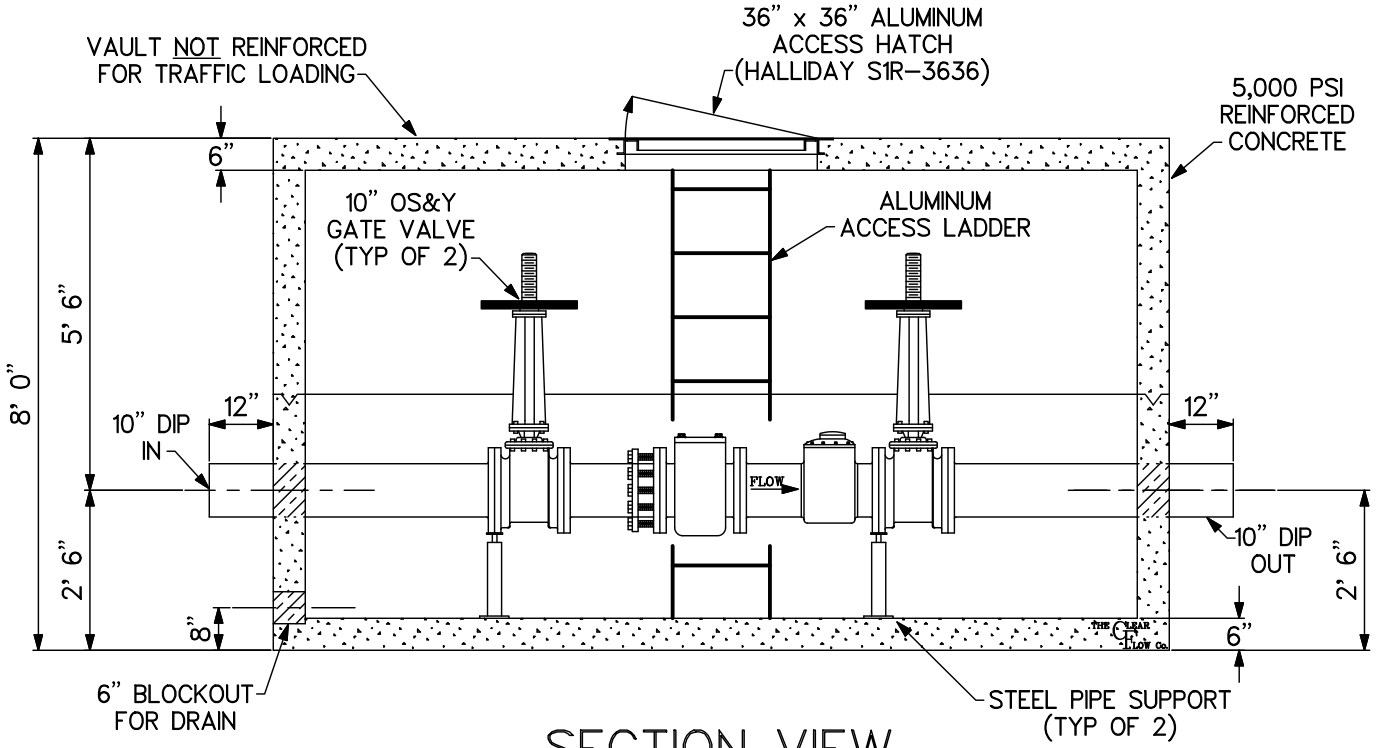

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 38,000 LBS.
2. 10" METER w/PLATE STRAINER
3. VAULT ALSO AVAILABLE WITH H20 LOAD RATING

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 6/12/08	DWG: MTR10-3500

10" MASTER METER VAULT

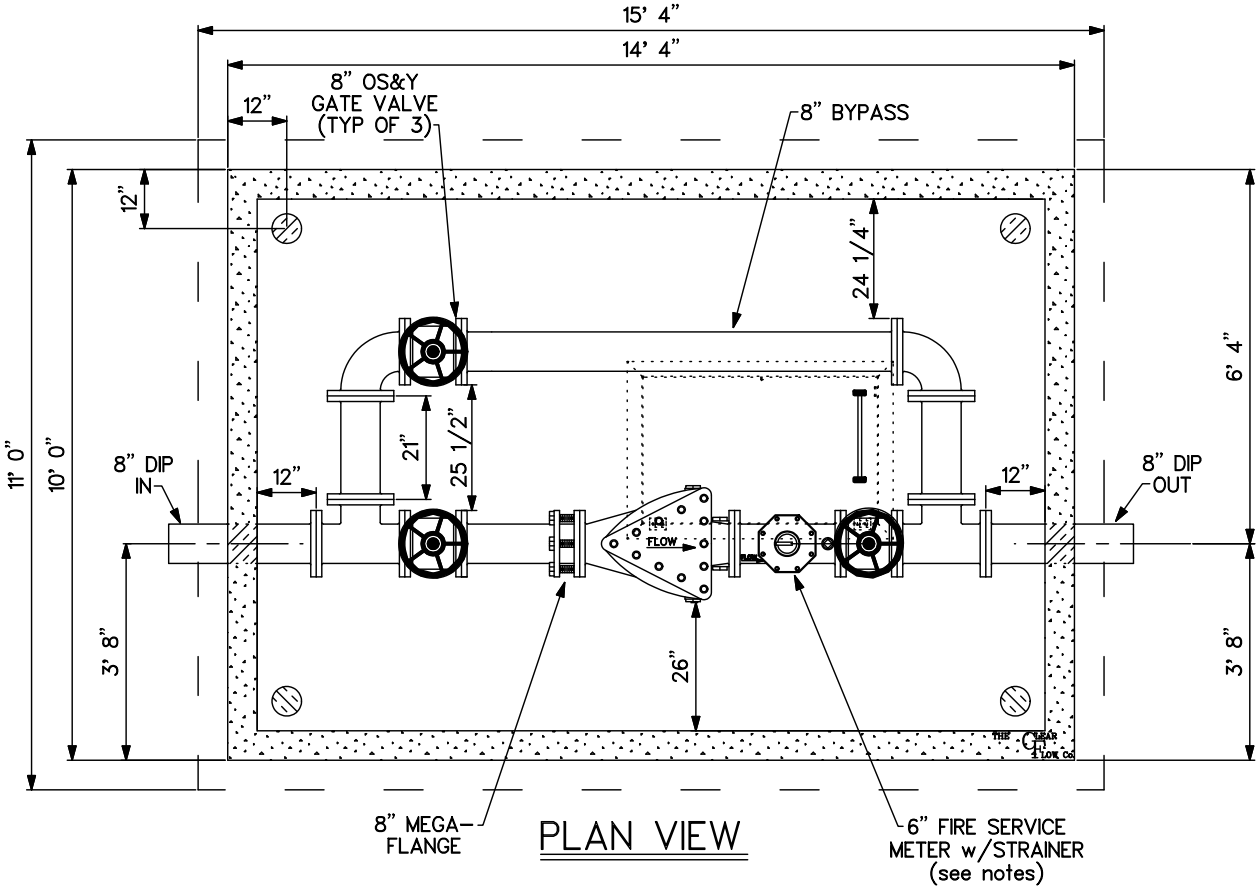

PLAN VIEW

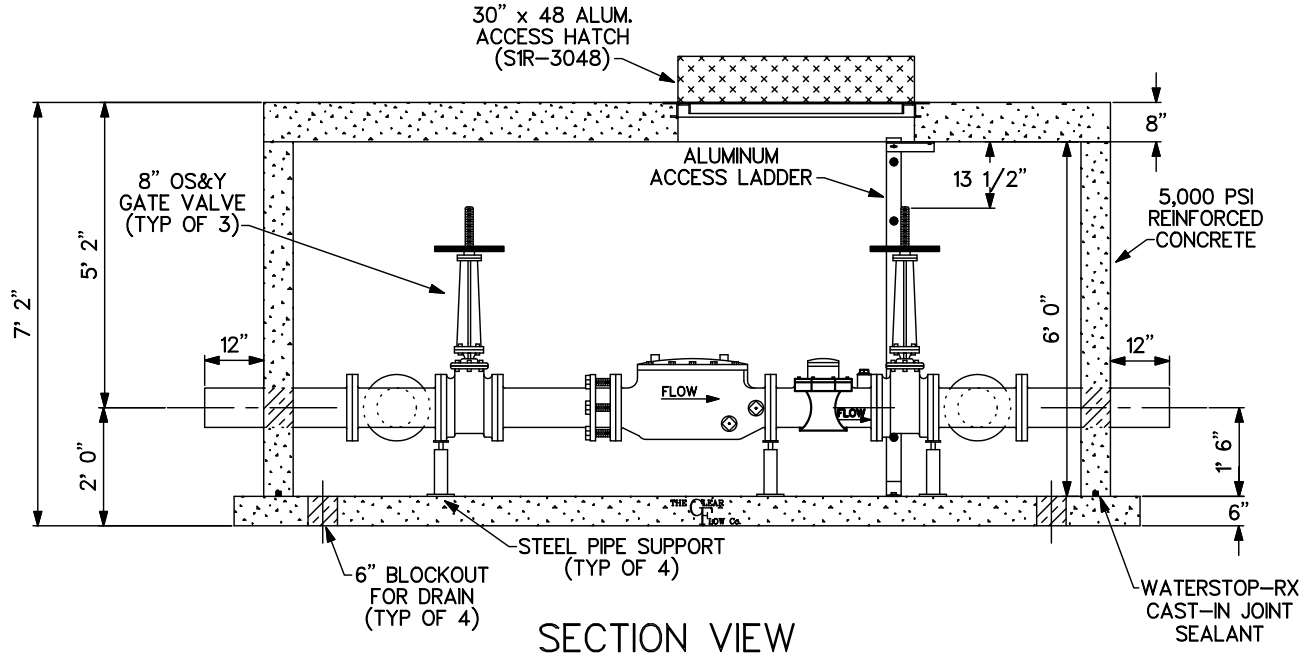

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED WITH TOP LOOSE, HEAVIEST LIFT APPROXIMATELY 45,000 LBS.
2. 8" SENSUS F2 FIRELINE FIRE SERVICE METER w/STRAINER (UL APPROVED STRAINER)

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 9/03/99	DWG: MTR8-FM-BYPASS-CUSTOM

8" FIRE SERVICE MASTER METER VAULT WITH 8" BYPASS

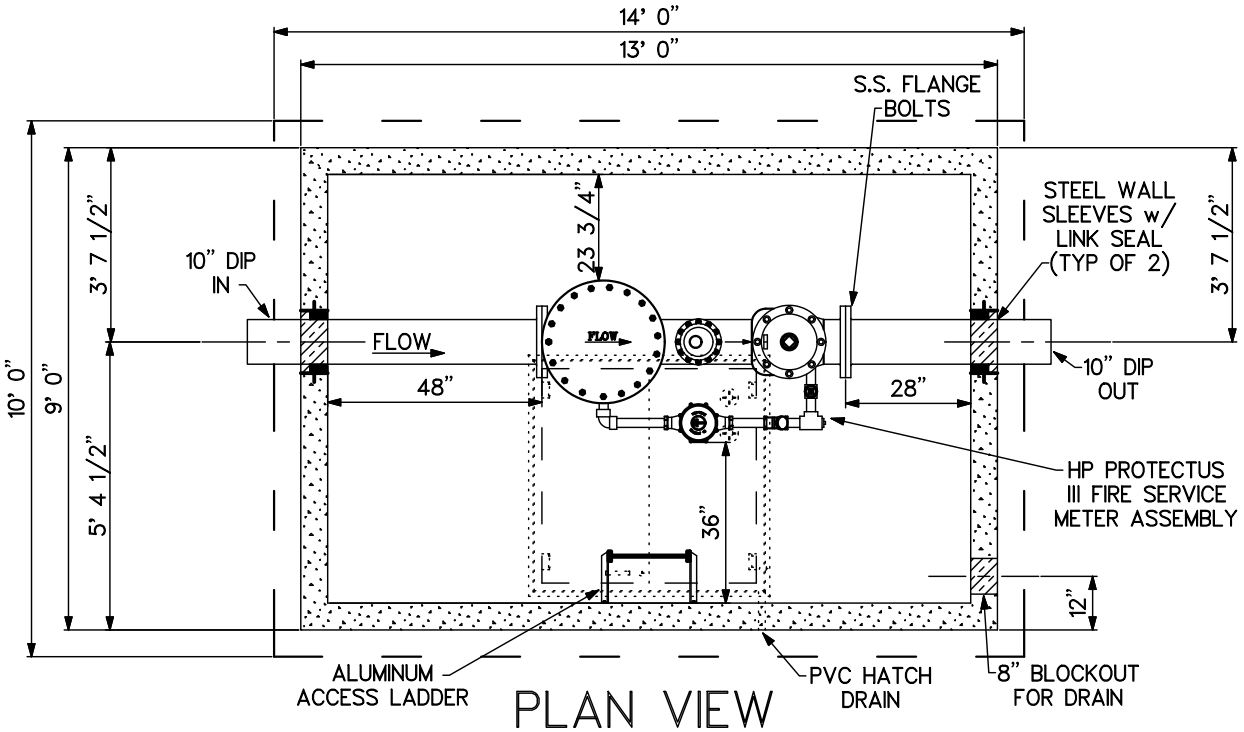

PLAN VIEW

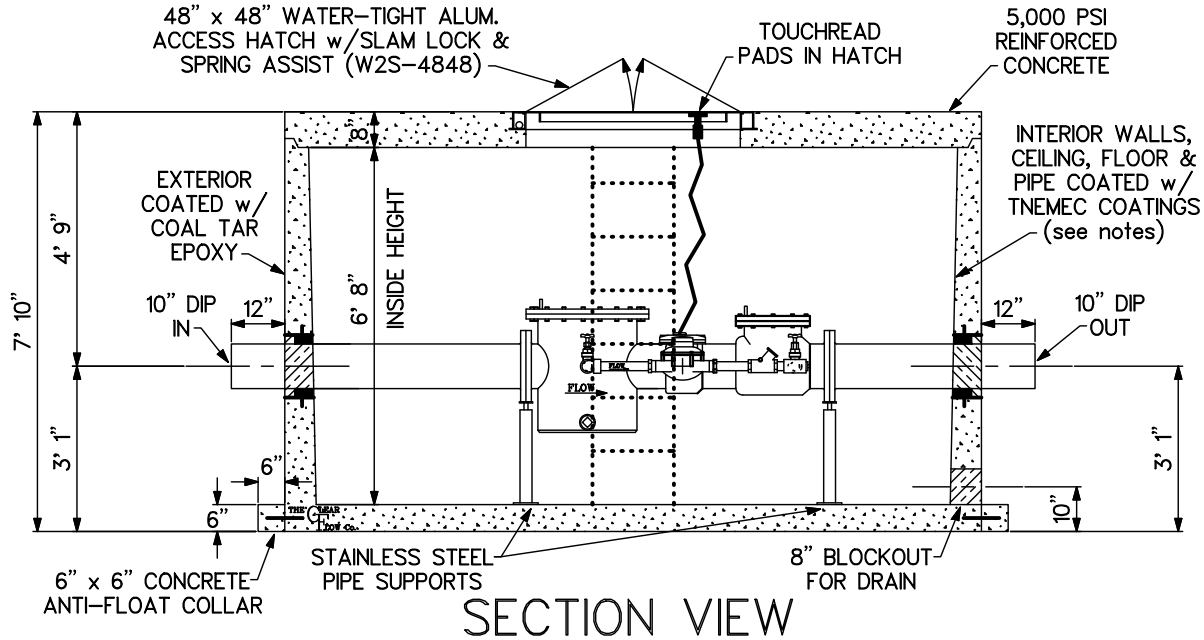

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 44,000 LBS.
2. 10" HP PROTECTUS III FIRE SERVICE METER ASSEMBLY w/2" METERED BYPASS & PRO-READ (METER ASSEMBLY FLANGE BOLTS ARE AS SUPPLIED FROM THE FACTORY)
3. COATING SCHEDULE:
   PIPE & FITTINGS (EXCEPT BRASS OR S.S.) – PRIME COAT – TNEMEC EPOXY #135 – WHITE
   INTERMEDIATE COAT – TNEMEC EPOXY #27 – ALUMINUM
   FINISH COAT – TNEMEC ACRYLIC POLYURETHANE #1074 – BK33 GRAY ANSI No. 61

** FLANGE BOLTS TO BE S.S. AND COATED WITH THE PIPING AFTER ASSEMBLY
   VAULT EXTERIOR (BELOW GRADE) – TNEMEC COAL TAR EPOXY # 46H-413 – BLACK
   VAULT INTERIOR – WALLS & CEILING – PRIME COAT – TNEMEC ACYLIC FILLER #130-6602 – OFF-WHITE
   INTERMEDIATE COAT – TNEMEC ACRYLIC EPOXY #113 – AL82 WARM SUN
   FINISH COAT – TNEMEC ACRYLIC EPOXY #114 H.B. – WH02 TANK WHITE
   VAULT FLOOR – TWO (2) COATS – TNEMEC ACRYLIC POLYAMINE EPOXY #201

CLEAR FLOW BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 – 2678

SCALE: NONE	DATE: 2007	DWG: MTR10-FM-JAMESCITYCO

10" MASTER METER VAULT (JAMES CITY COUNTY STANDARD)

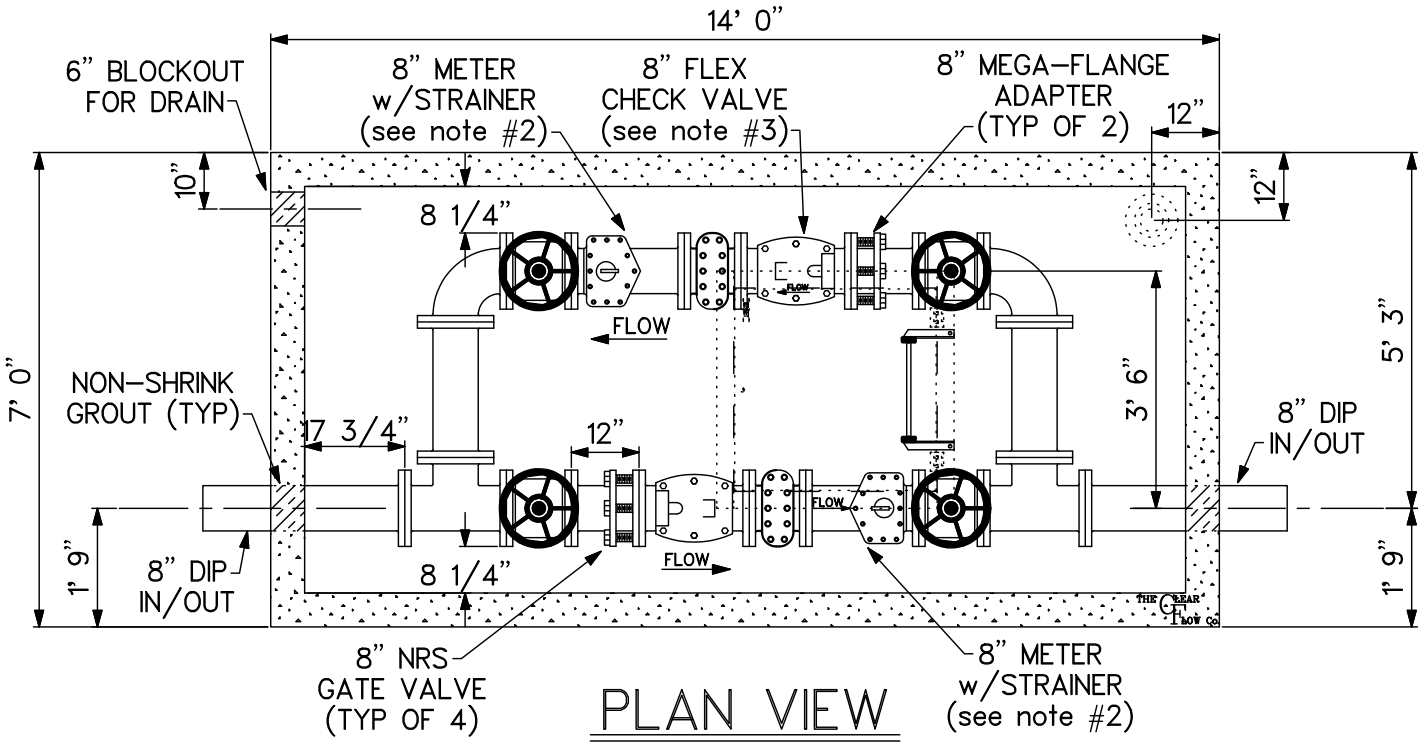

PLAN VIEW

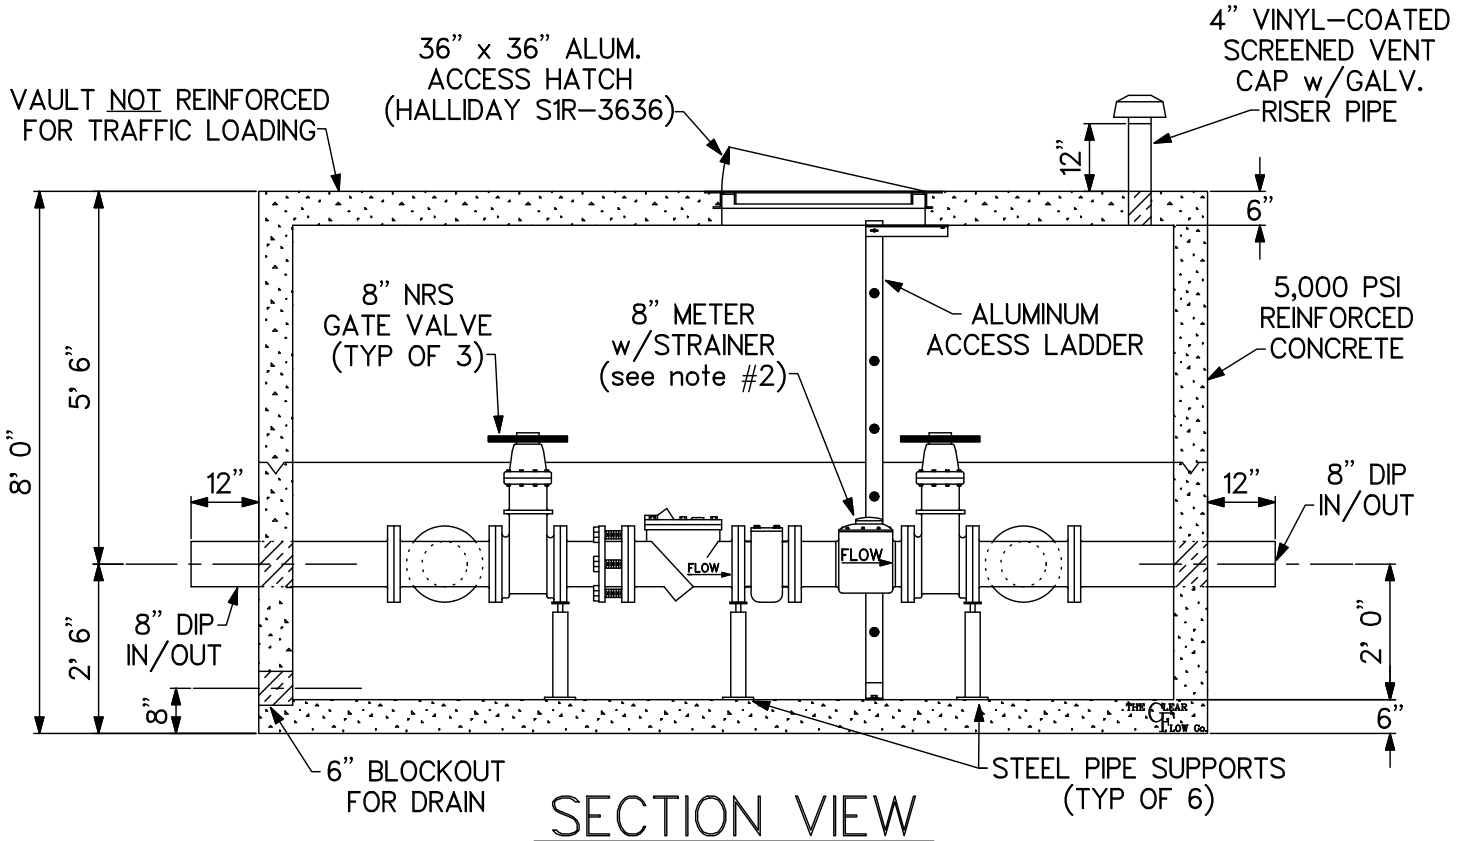

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 38,000 LBS.
2. TWO (2) 8" TURBO METERS w/PLATE STRAINERS
3. TWO (2) 8" CLA-VAL MODEL #584 SWING FLEX CHECK VALVE

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE:	DWG: MTR8-TWO-WAY FLOW-3500

8" TWO-WAY FLOW METER VAULT

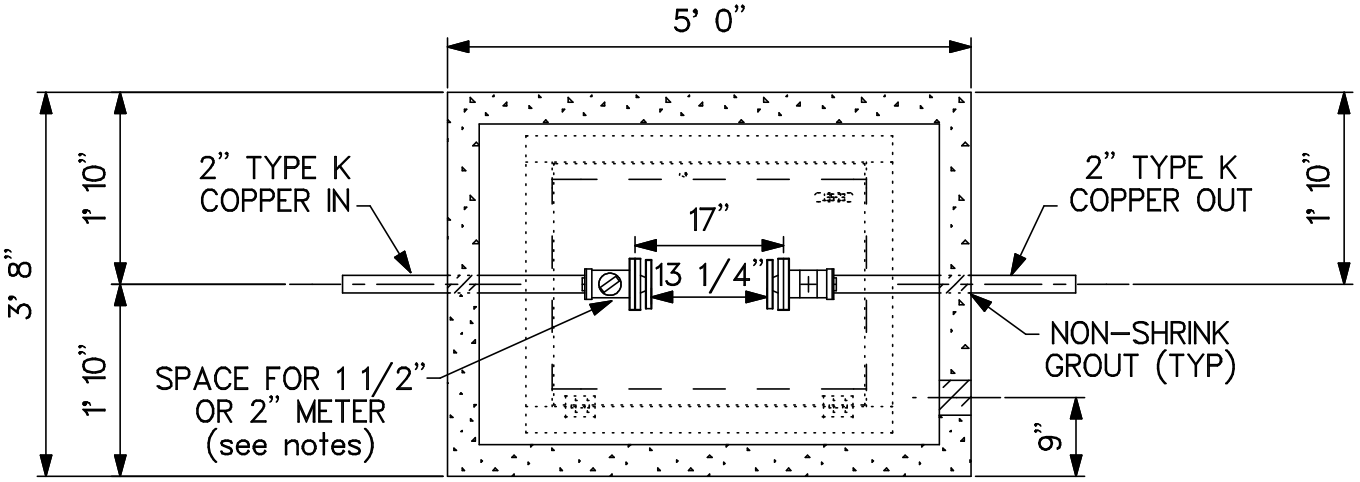

PLAN VIEW

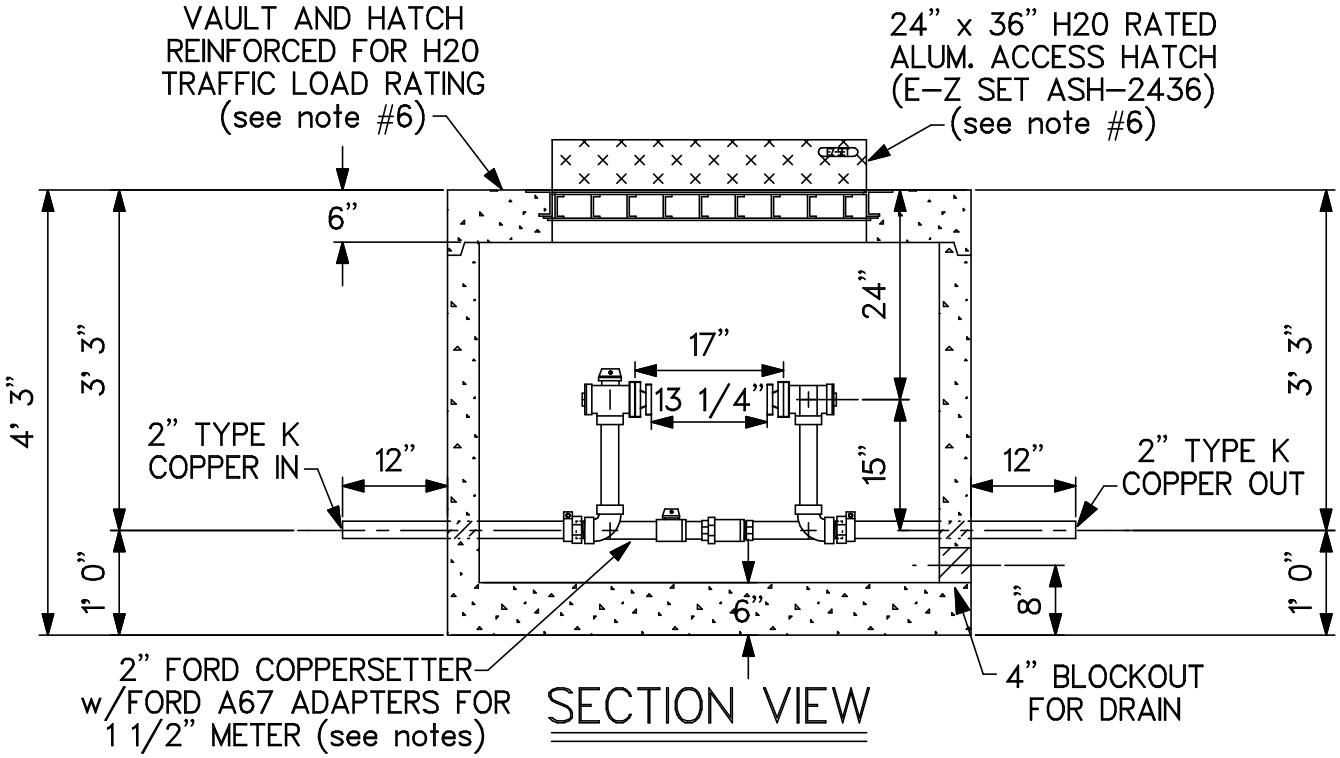

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULTS SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 6,000 LBS. EACH
2. 2" FORD COPPERSETTER MODEL # VBHH77-15BHC-44-77 (BALL VALVE INLET, ANGLE DUAL CHECK OUT & CARTRIDGE DUAL CHECK ON BYPASS) CTS COMPRESSION ENDS
3. FORD A67 METER ADAPTERS SUPPLIED FOR 1 1/2" METER FLANGE & LENGTH
4. METERS SUPPLIED & INSTALLED BY OTHERS.
5. TWELVE (12) METER VAULTS TO BE SUPPLIED. IF A DIFFERENT NUMBER OF VAULTS ARE NEEDED, CONTRACTOR SHALL NOTIFY CLEAR FLOW PRIOR TO RELEASE FOR PRODUCTION
6. TRAFFIC RATED ALUMINUM ACCESS HATCHES ARE DESIGNED FOR OFF-STREET USE IN LOW-DENSITY TRAFFIC AREAS ONLY

DESIGN		
DRAWN	STEVEN L. GORDON	
CHECKED	CRAIG A. SHREWSBURY	
APPROVED		
REVISIONS		DATE
H20 HATCH & VAULT; 6" TOP & BOTTOM;		4/22/09
12 VAULTS TO BE PROVIDED		

CLEAR FLOW
BY AMERICAST
1321 NORTH DELPHINE AVE.
WAYNESBORO, VA 22980
(540) 942 - 3300

REF. NO. P-30597-S

WINCHESTER, VIRGINIA

WINCHESTER DOWNTOWN INFRASTRUCTURE IMP.

1 1/2" METER VAULTS

* PRINTOUT NOT TO ANY SCALE *

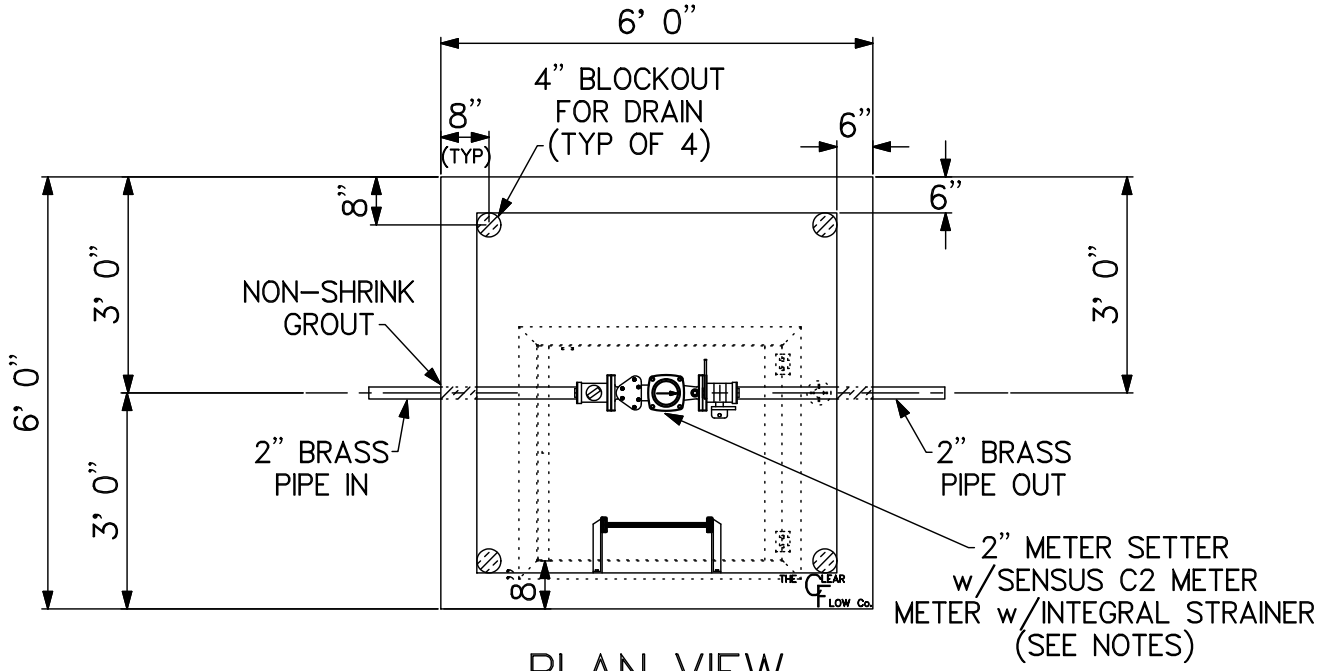

PLAN VIEW

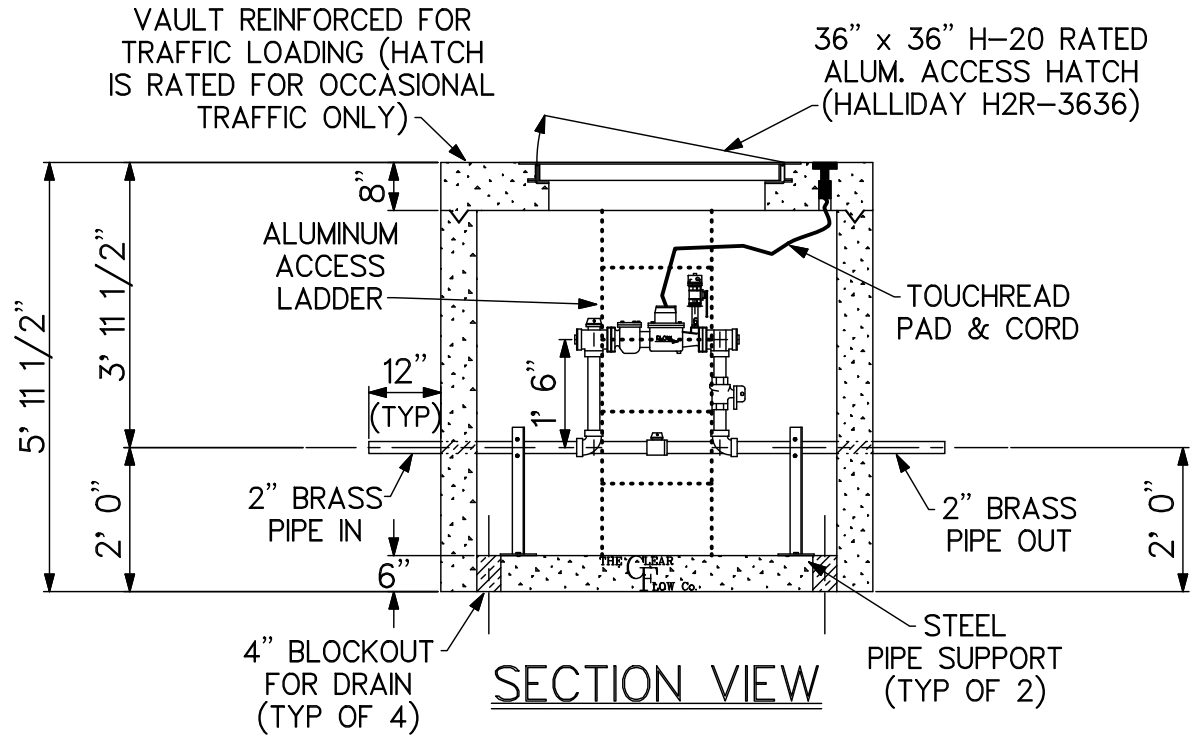

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 18,000 LBS.
2. 2" FORD METER SETTER MODEL VBHH77-95037-084 (BALL VALVE IN; DUAL CHECK & ADDITIONAL BALL VALVE OUT)
3. 2" SENSUS C2 COMPOUND METER w/ INTEGRAL STRAINER, TOUCHREAD & 1 1/2" TEST PORT (1 1/2" x 6" NIPPLE; 1 1/2" x 2" HEX BUSHING; 2" BALL VALVE w/LEVER; 2" x 2 1/2" NST ADAPTER (MxM) & 2 1/2" NST CAP)

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 8/09/05	DWG: MTR2-ROCKBRIDGE CO-6060

2" METER VAULT (6060 STRUCTURE) (ROCKBRIDGE COUNTY)

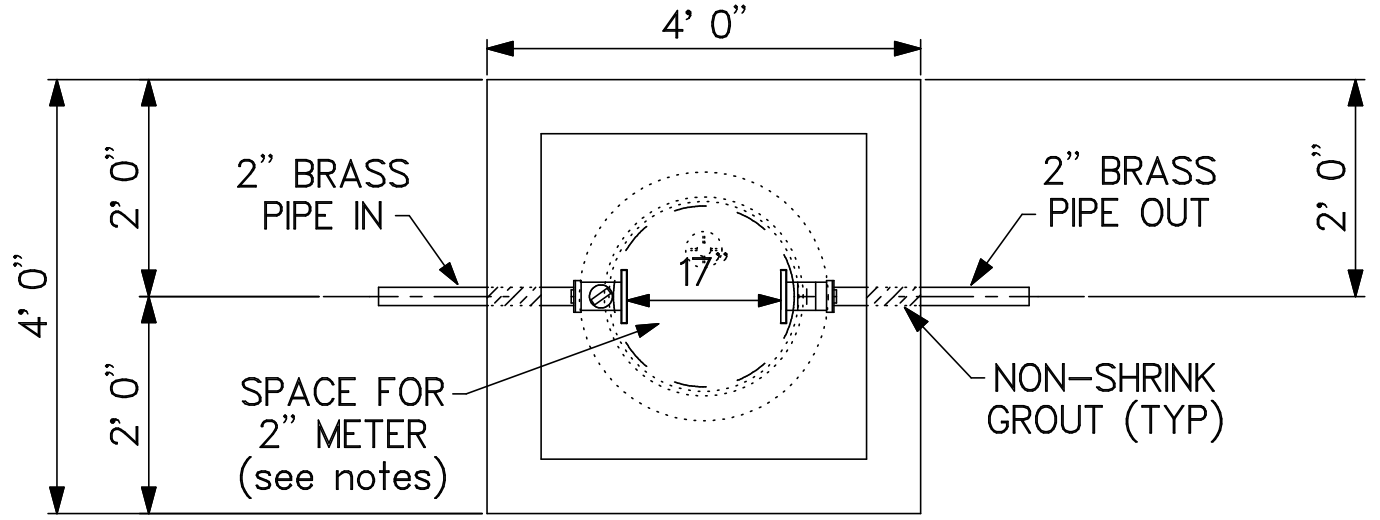

PLAN VIEW

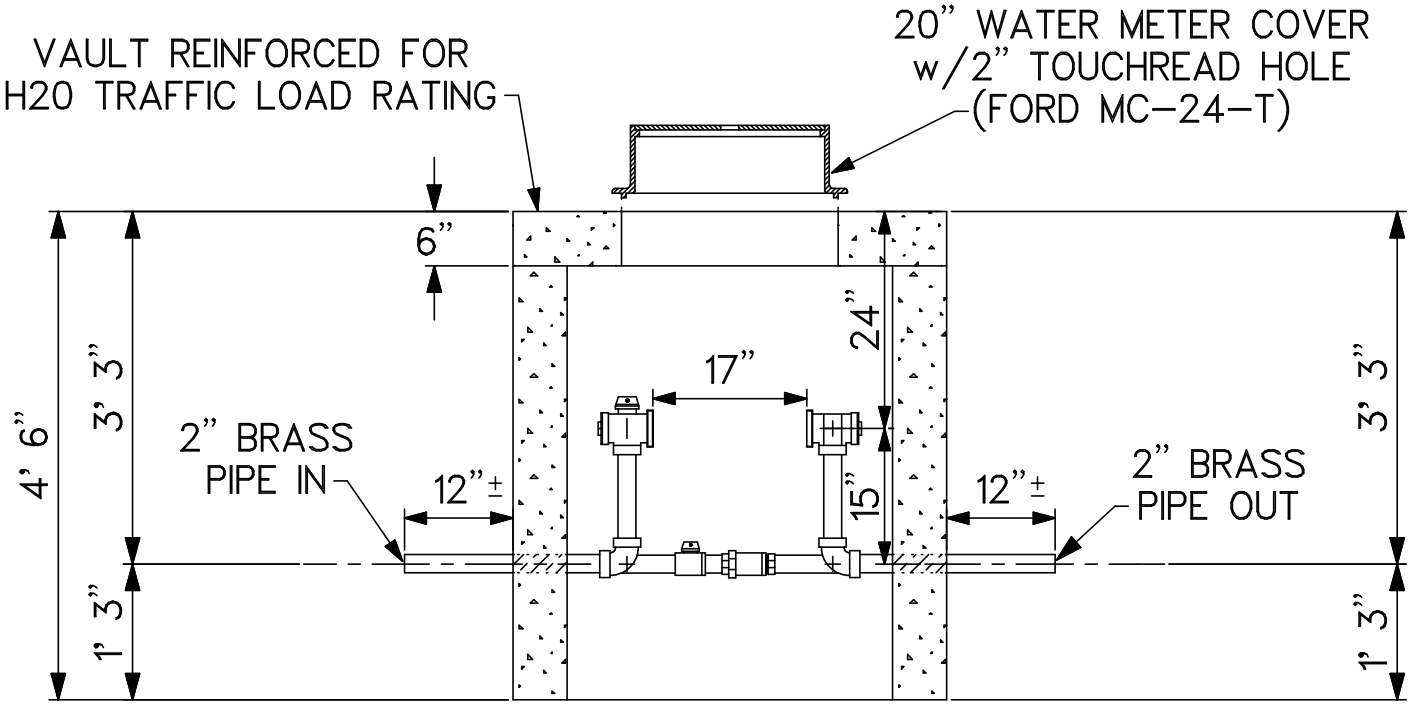

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULTS SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 6,000 LBS. EACH
2. 2" FORD COPPERSETTER MODEL # VBHH77-15BHC-11-77 (BALL VALVE INLET, ANGLE DUAL CHECK OUT & CARTRIDGE DUAL CHECK ON BYPASS) FIP THREADED ENDS
3. METER SUPPLIED & INSTALLED BY OTHERS.
4. METER COVER SHIPPED LOOSE FOR INSTALLATION BY THE SITE CONTRACTOR

DESIGN		8/15/13
DRAWN	STEVEN L. GORDON	
REVISIONS		DATE

CLEAR FLOW
BY AMERICAST
210 STONE SPRING ROAD
HARRISONBURG, VA 22801
(540) 434 - 2130

STAFFORD COUNTY, VIRGINIA

STAFFORD COUNTY 2" WATER METER VAULT

* PRINTOUT NOT TO ANY SCALE *

REF. NO. MTR2-STAFFORD

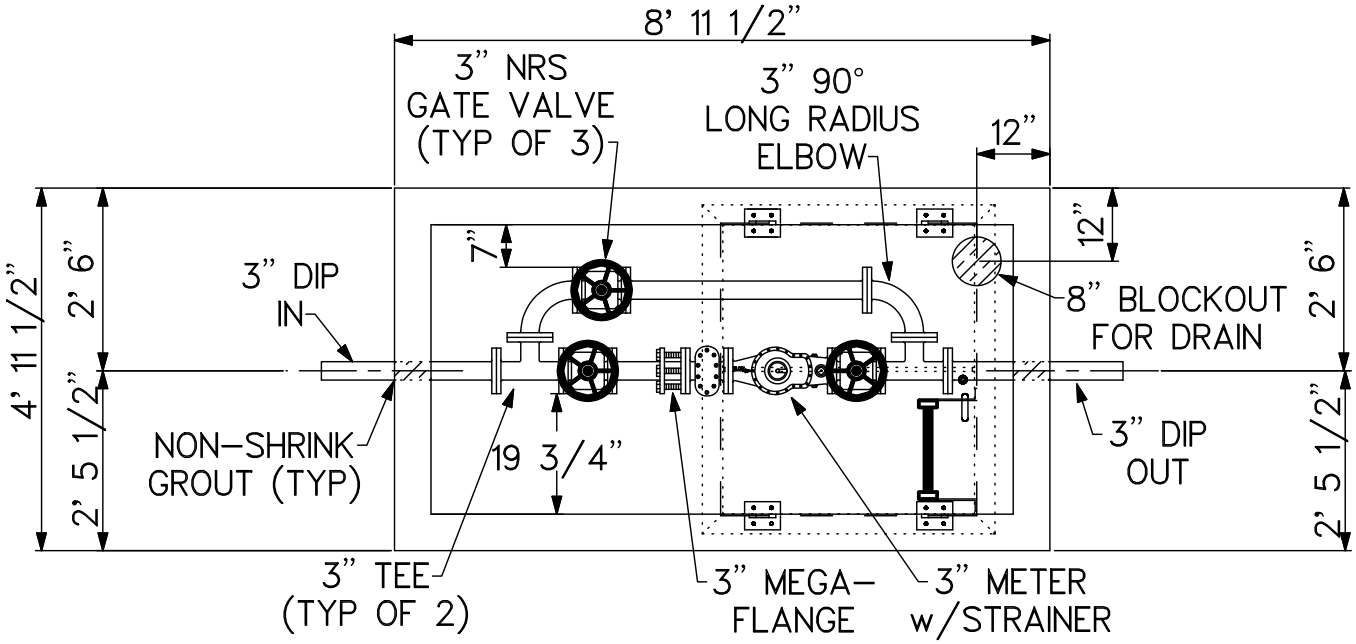

PLAN VIEW

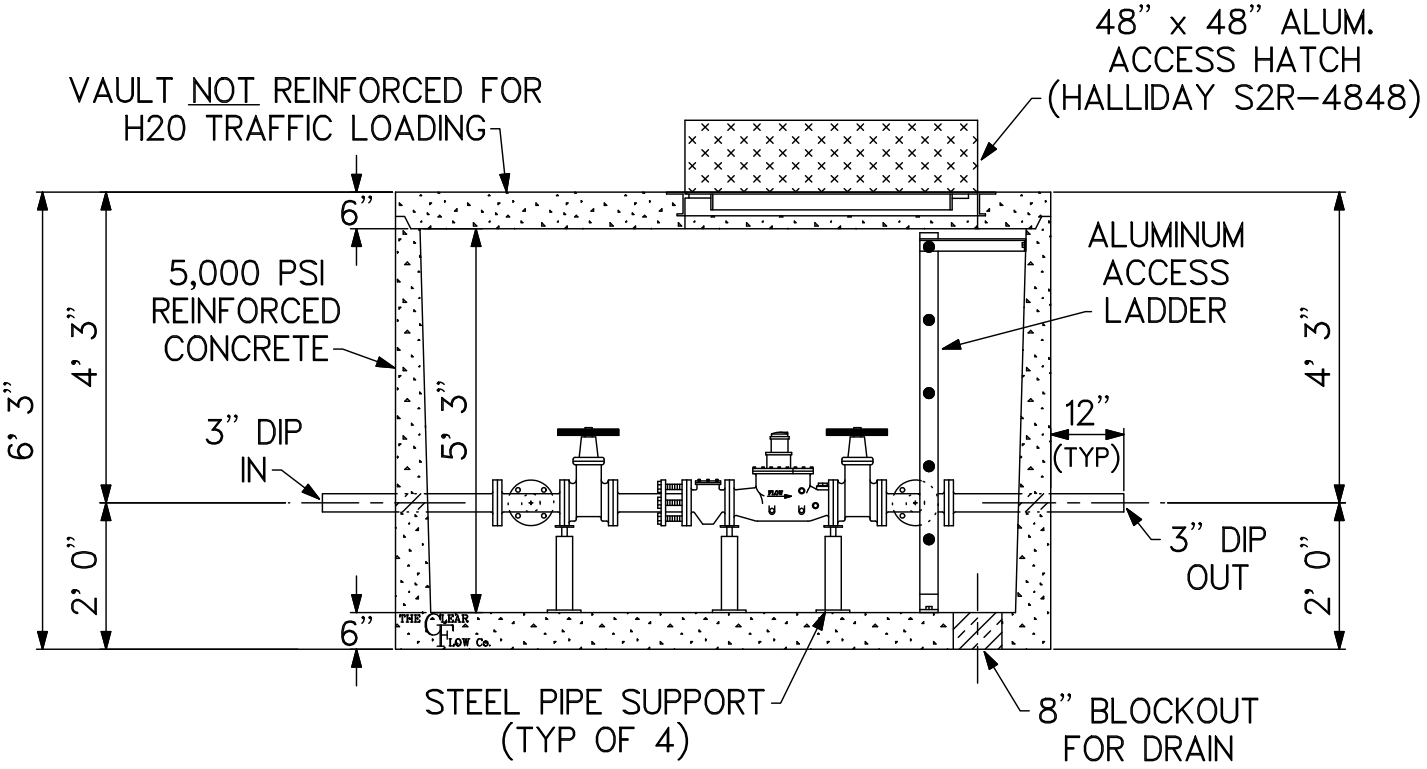

SECTION VIEW

NOTES:
1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 17,000 LBS.
2. 3" METER w/STRAINER (GALLONS)

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 11/06/07	DWG: MTR3-1000

3" WATER METER VAULT
(TJ-1000 STRUCTURE)

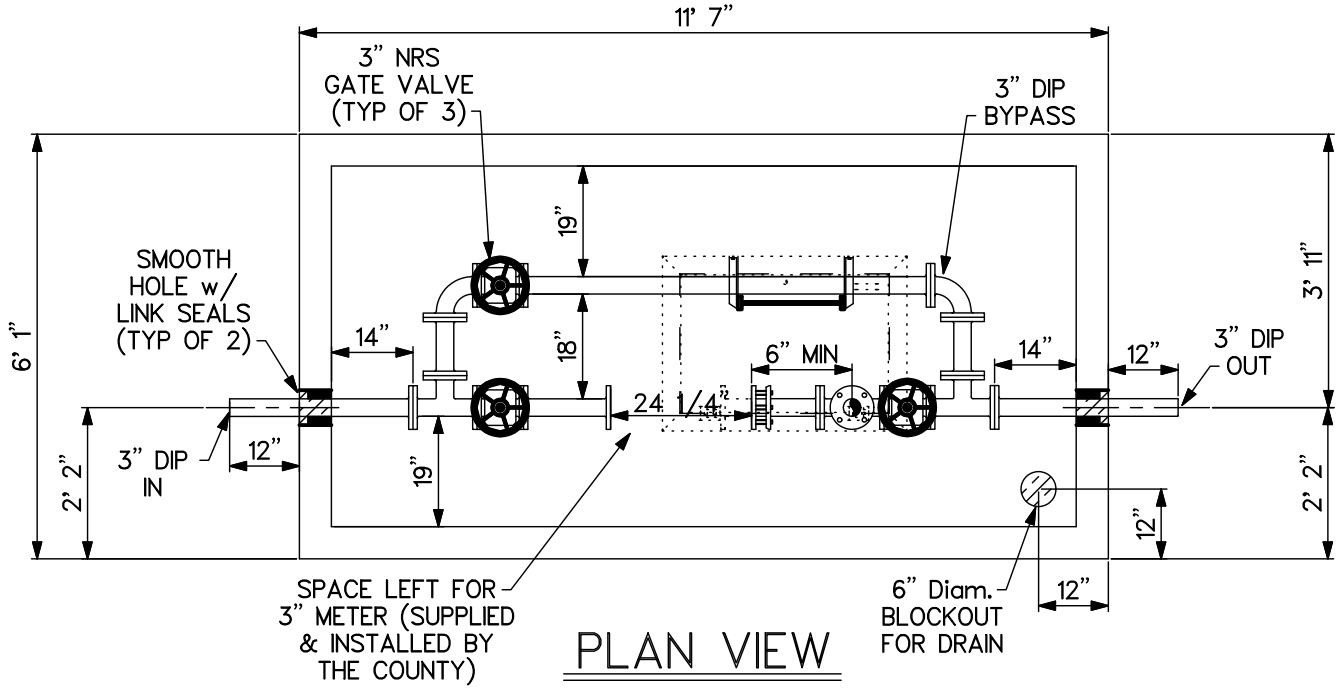

PLAN VIEW

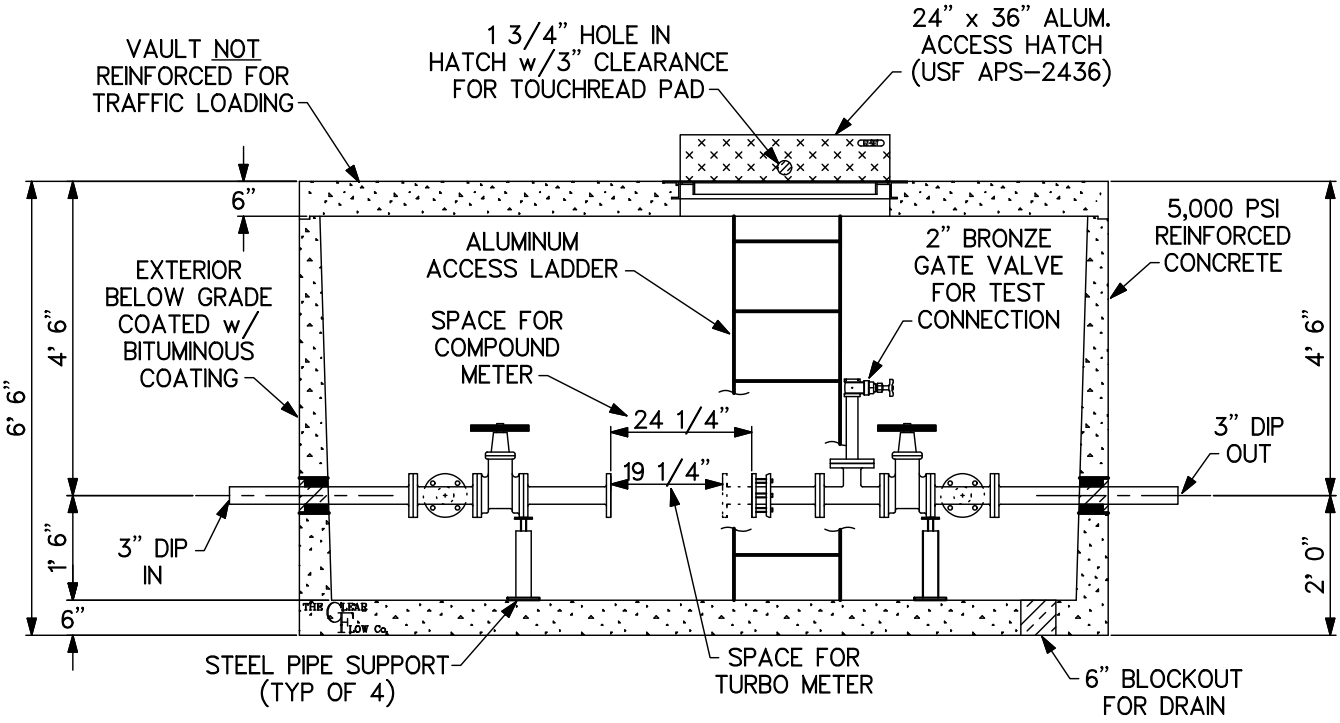

SECTION VIEW

NOTES:

1. CLEAR FLOW METER VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 25,000 LBS. VAULT MUST BE SET WITH CONTRACTOR SUPPLIED CRANE.
2. 29 1/4" SPACE LEFT FOR METER TO BE SUPPLIED AND INSTALLED BY OTHERS. IF DIFFERENT SPACING IS REQUIRED NOTIFY CLEAR FLOW PRIOR TO PRODUCTION.

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 2007	DWG: MTR3-ALBEMARLE CO

3" WATER METER STRUCTURE (ALBEMARLE COUNTY STANDARD)

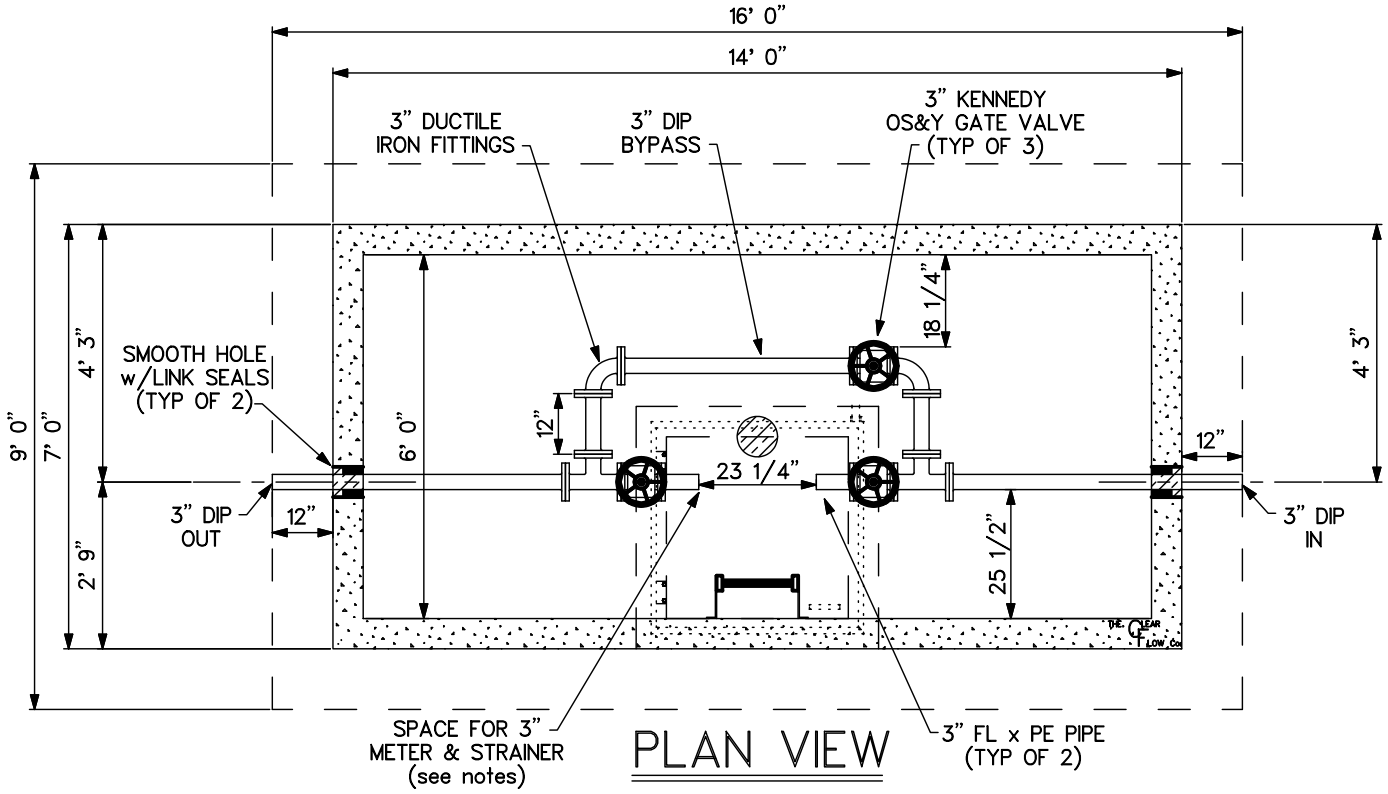

PLAN VIEW

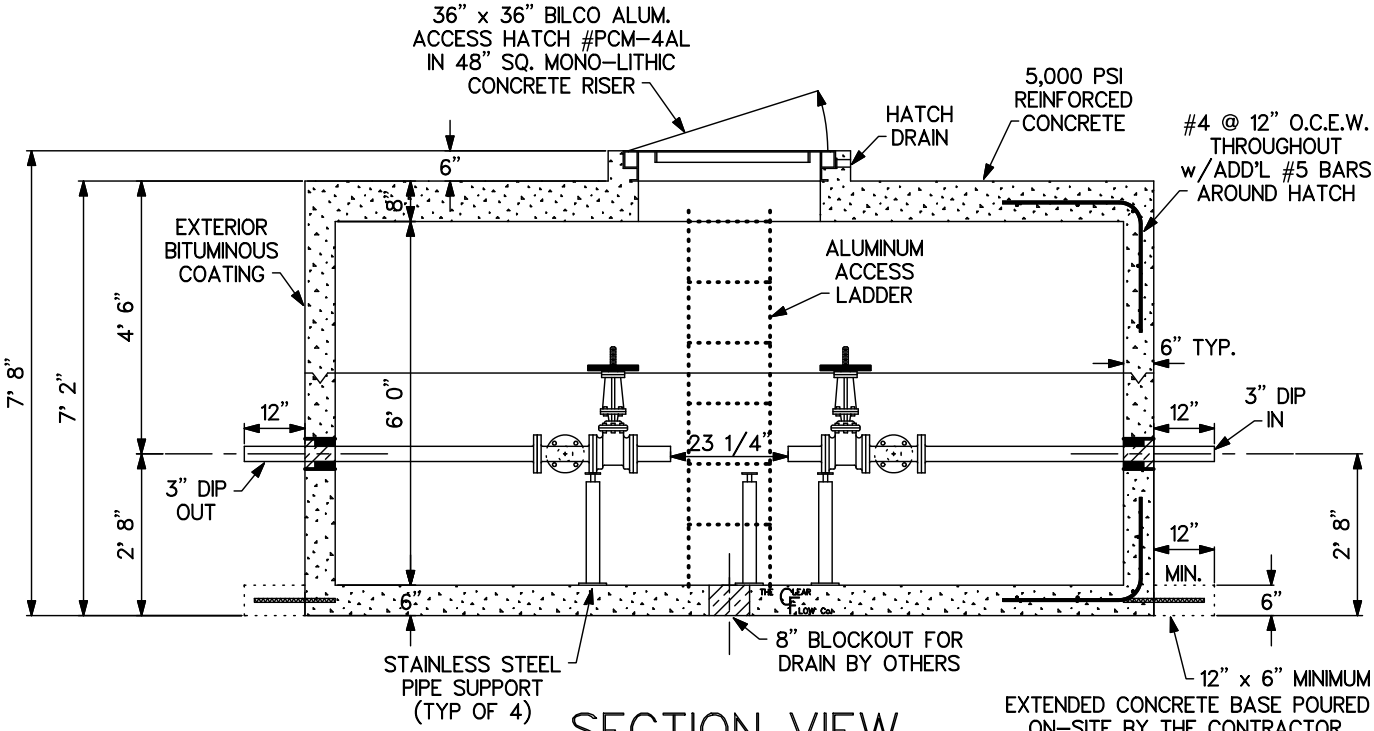

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 42,000 LBS.
2. 24" SPACE LEFT FOR 3" METER & STRAINER PROVIDED & INSTALLED BY OTHERS

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 4/20/11	DWG: MTR3-CITY OF FAIRFAX

CITY OF FAIRFAX
3" WATER METER VAULT

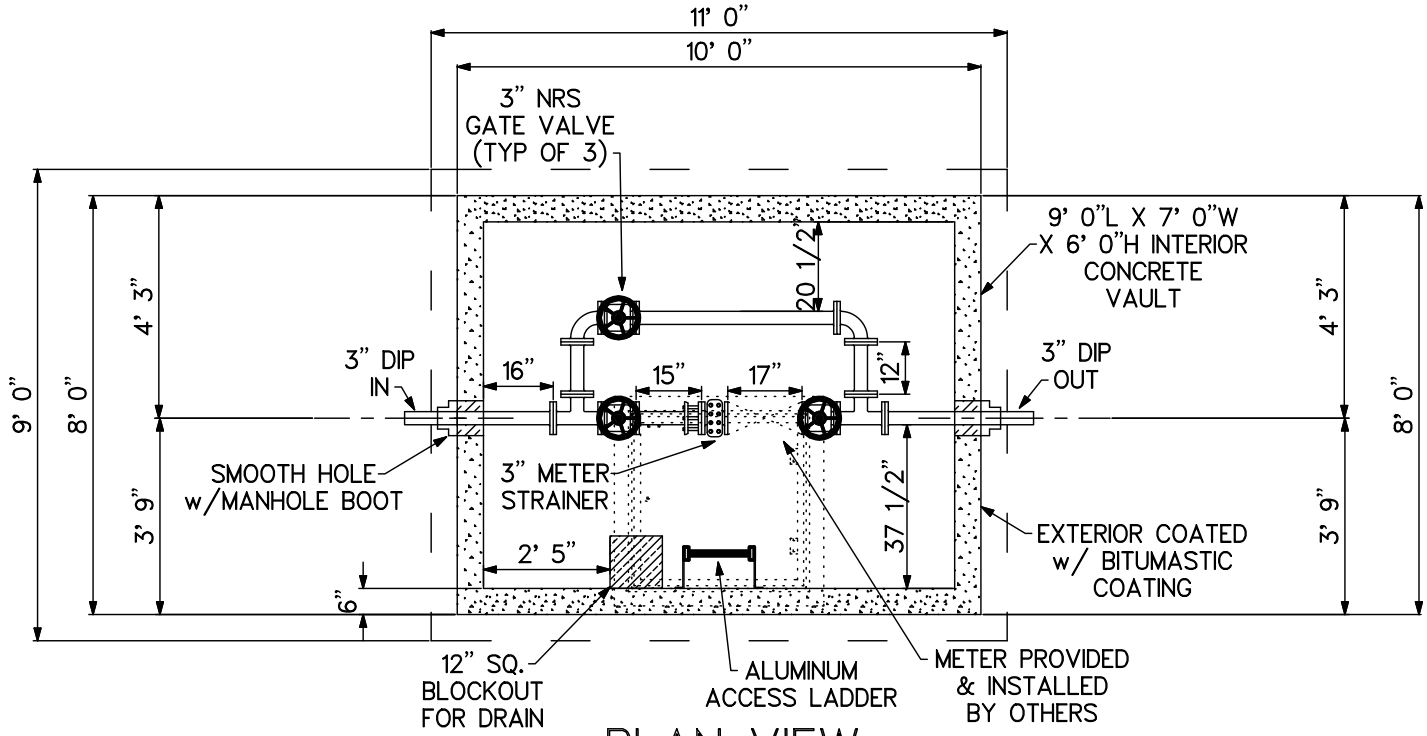

PLAN VIEW

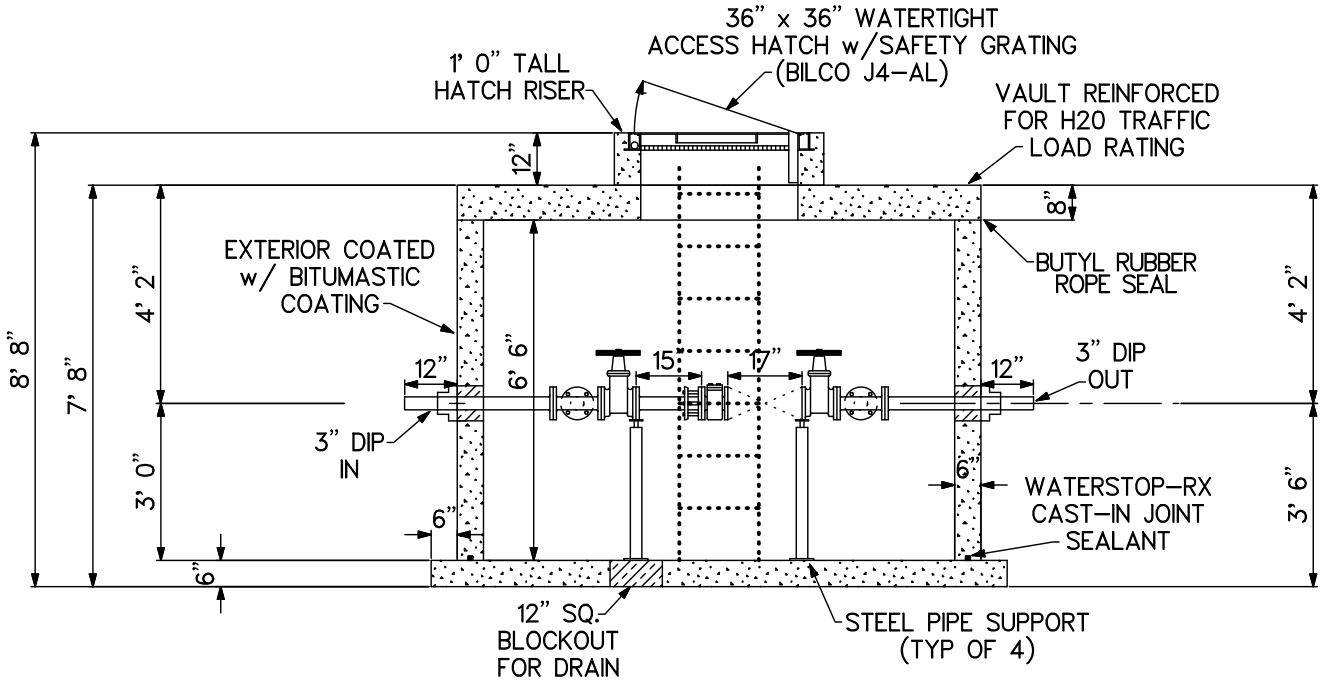

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 35,000 LBS.
2. WATER METER PROVIDED AND INSTALLED BY OTHERS.
3. EXTERIOR COATED WITH BITUMASTIC COATING.
4. ALL ELECTRICAL WORK BY OTHERS.

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 12/02/09	DWG: MTR3-LOUDOUN CO

3" WATER METER VAULT (LOUDOUN COUNTY STANDARD)

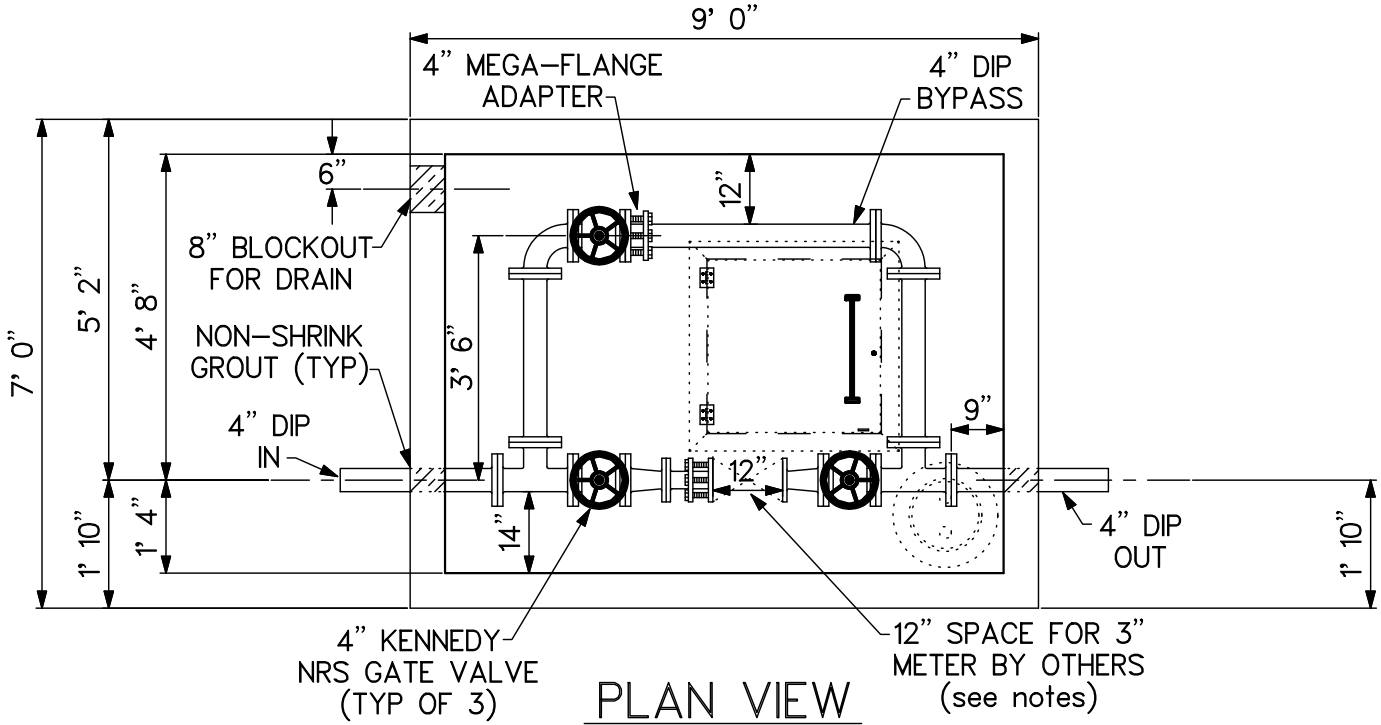

PLAN VIEW

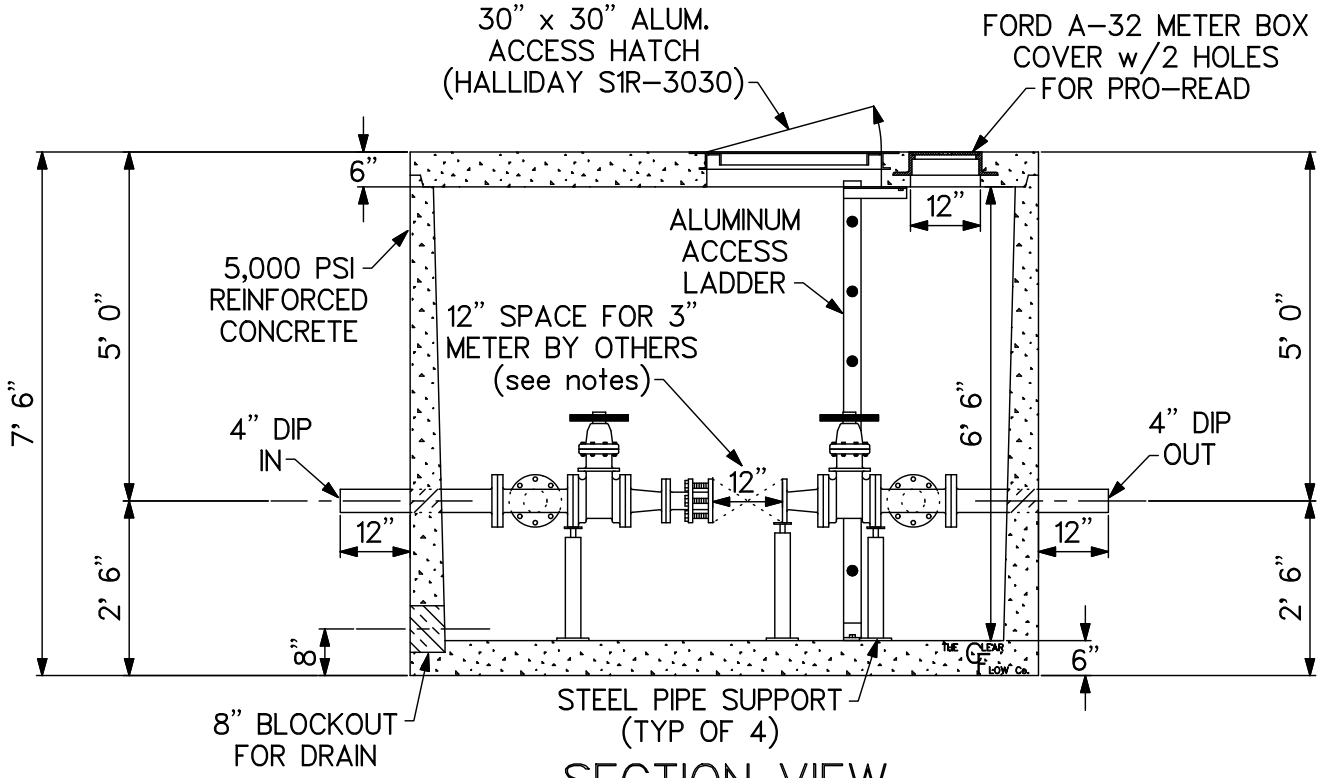

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 24,000 LBS.
2. 12" SPACE LEFT FOR 3" METER TO BE PROVIDED & INSTALLED BY OTHERS
3. CONTRACTOR TO VERIFY METER DIMENSIONS PRIOR TO RELEASE FOR PRODUCTION

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 11/07/12	DWG: MTR3-PRINCE WILLIAM CO-TJ6x8

3" WATER METER VAULT (PRINCE WILLIAM COUNTY STANDARD)

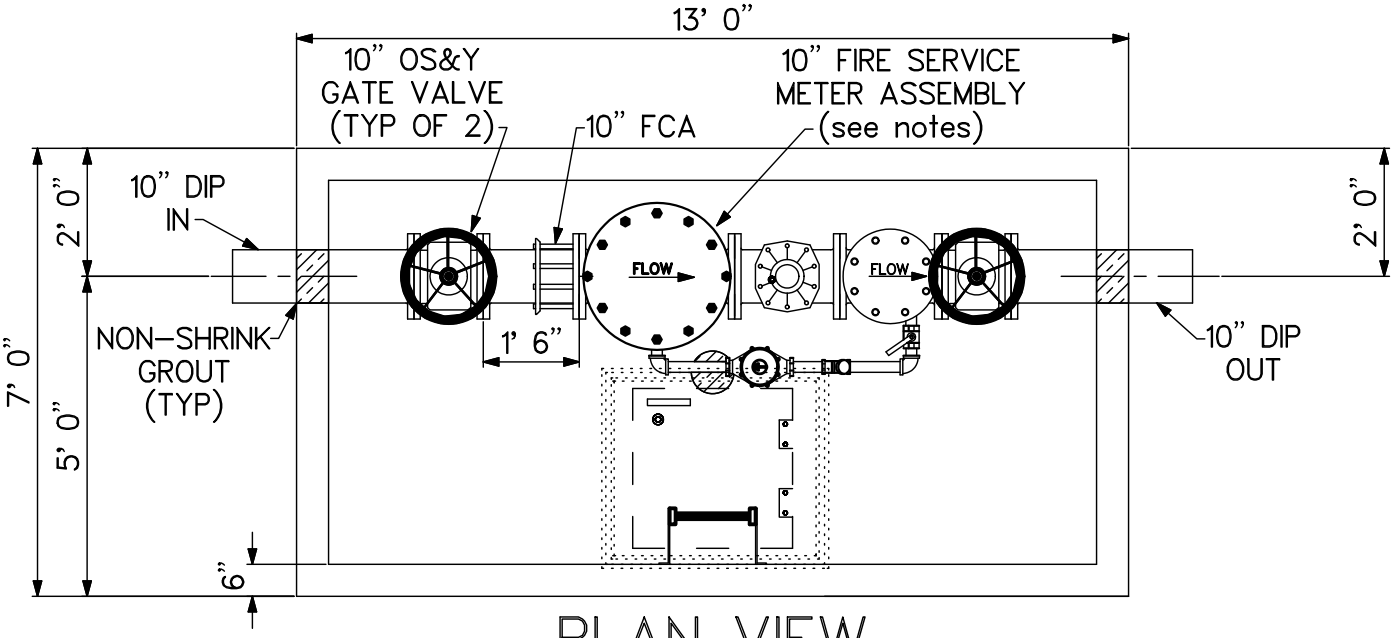

PLAN VIEW

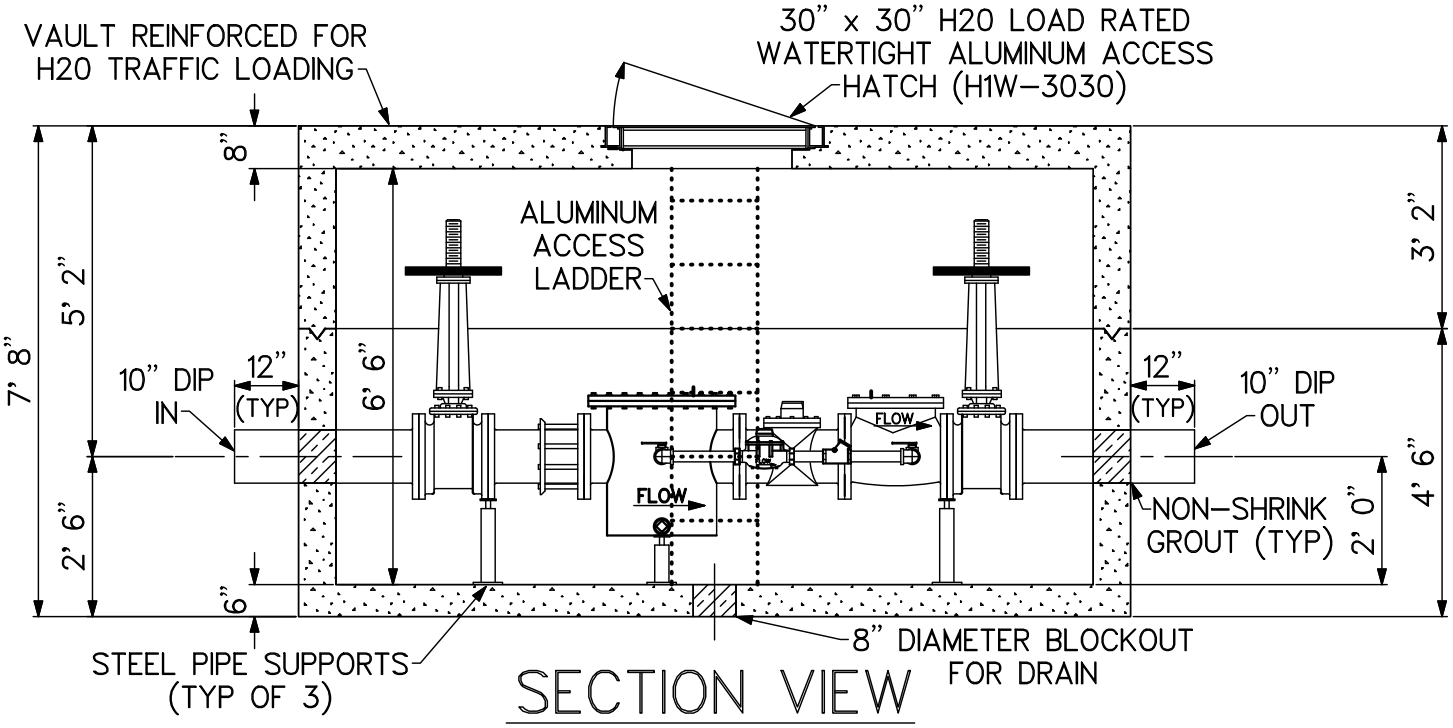

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED IN TWO SECTIONS WITH HEAVIEST LIFT WEIGHING APPROX. 23,000 LBS.
2. METER ASSEMBLY SUPPLIED BY TOWN OF BENSON.
3. TRAFFIC RATED ALUMINUM ACCESS HATCHES ARE DESIGNED FOR OFF-STREET USE IN LOW-DENSITY TRAFFIC AREAS ONLY

DESIGN		
DRAWN	VITALIY S. KIRILYUK	
REVISIONS		DATE
DUNN 6'x12' VAULT STRUCTURE		03/07/16

* PRINTOUT NOT TO ANY SCALE *

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
210 STONE SPRING ROAD
HARRISONBURG, VA 22801
(540) 434 - 6979

REF. NO.

TOWN OF BENSON, NORTH CAROLINA

TOWN OF BENSON 10" FIRE SERVICE METER VAULT

TOWN OF BENSON

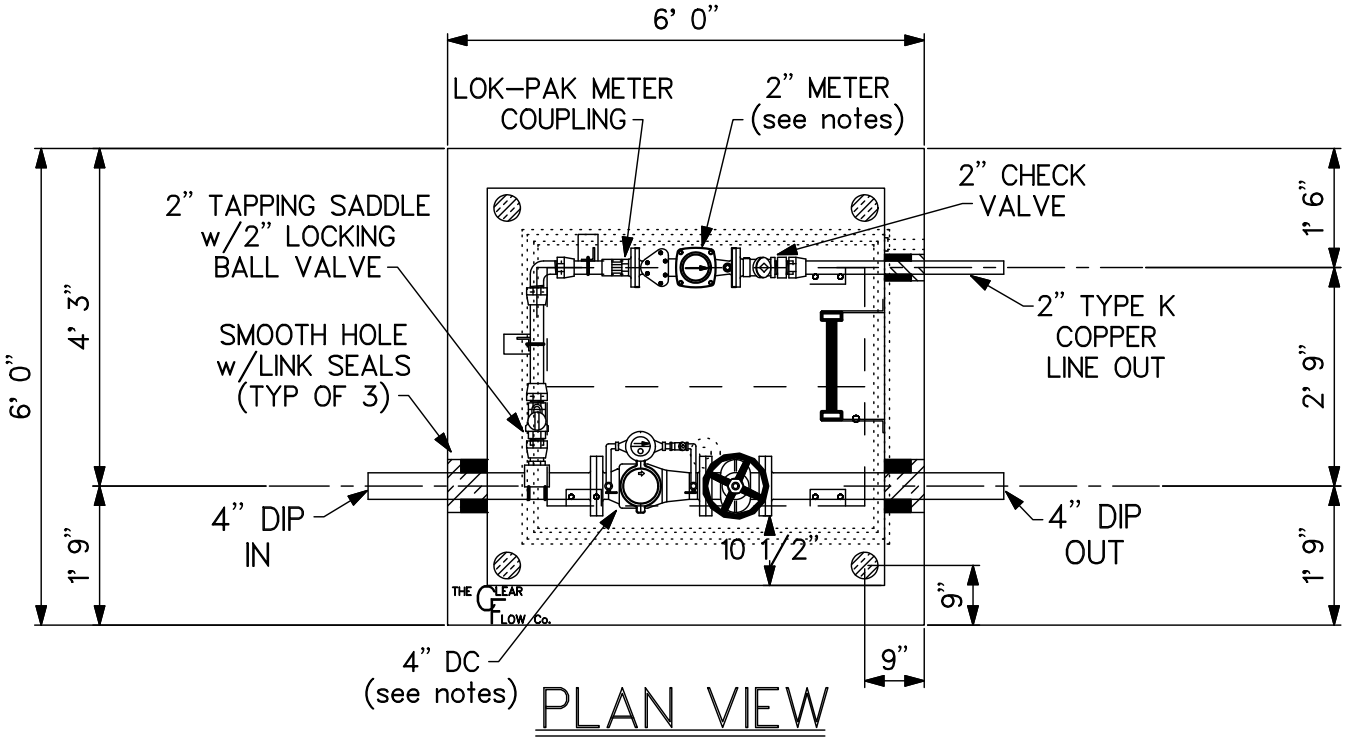

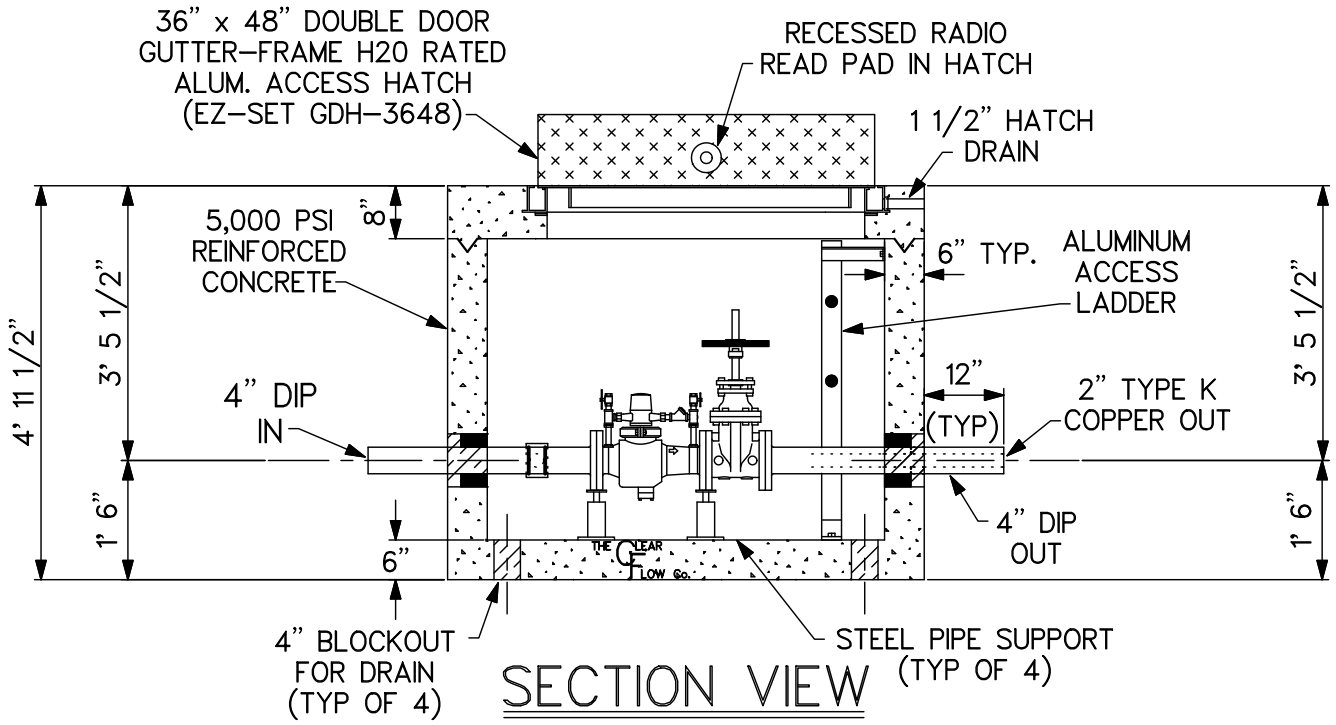

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 16,000 LBS.
2. 4" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/ONE OS&Y GATE VALVE
3. 2" DOMESTIC LINE IS TYPE K COPPER WITH GRIP JOINT FITTINGS, BALL VALVE AT TAPPING SADDLE (w/LOCKING TABS) & CHECK VALVE ON OUTLET
4. METERS SUPPLIED BY WVWA TO CLEAR FLOW & INSTALLED ON OUR YARD.

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 9/28/12	DWG: WVWA DC4x2

WVWA 4" DC VAULT w/2" DOMESTIC METER

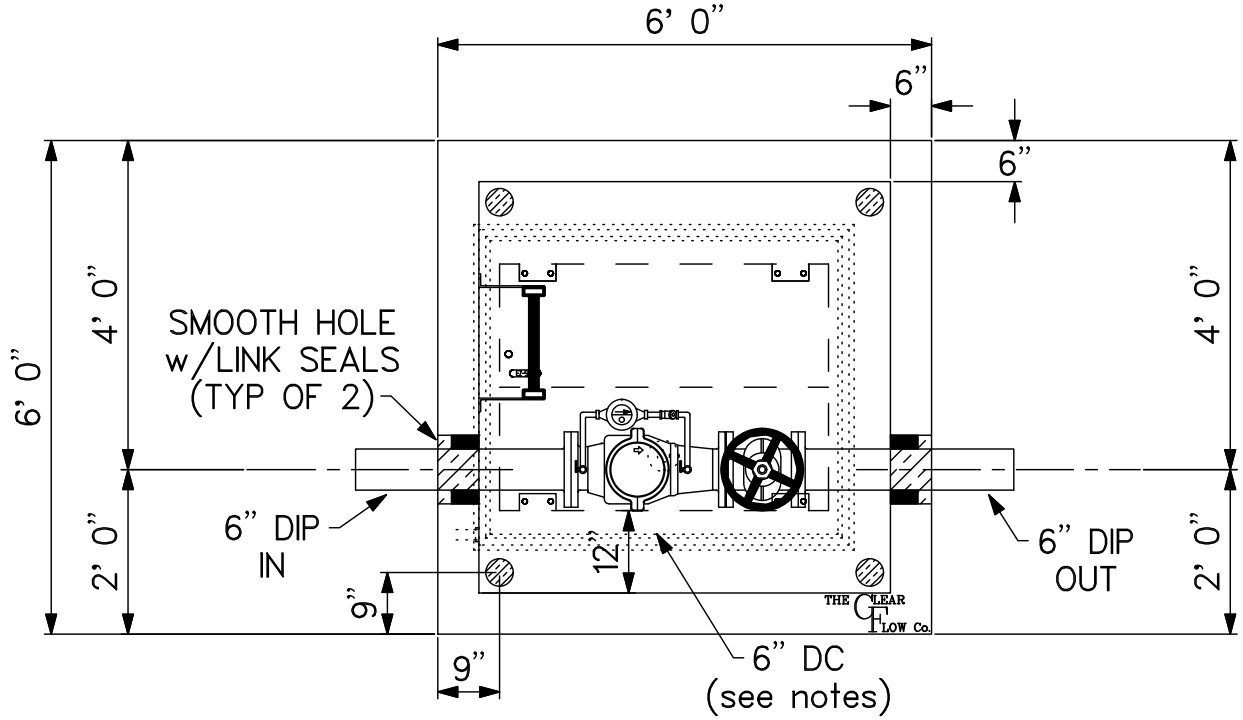

PLAN VIEW

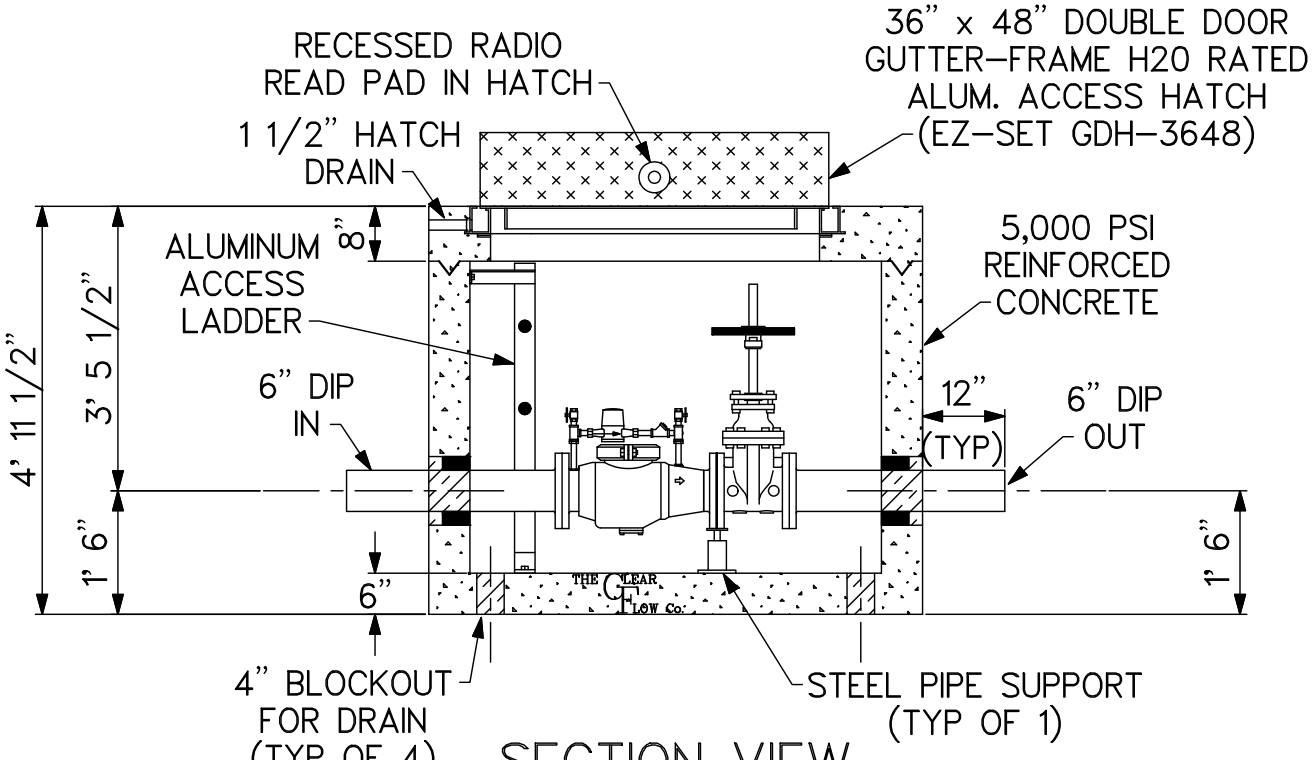

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 16,000 LBS.
2. 6" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/OS&Y GATE VALVE

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 9/28/12	DWG: WVWA DC6

WVWA 6" DETECTOR CHECK VAULT

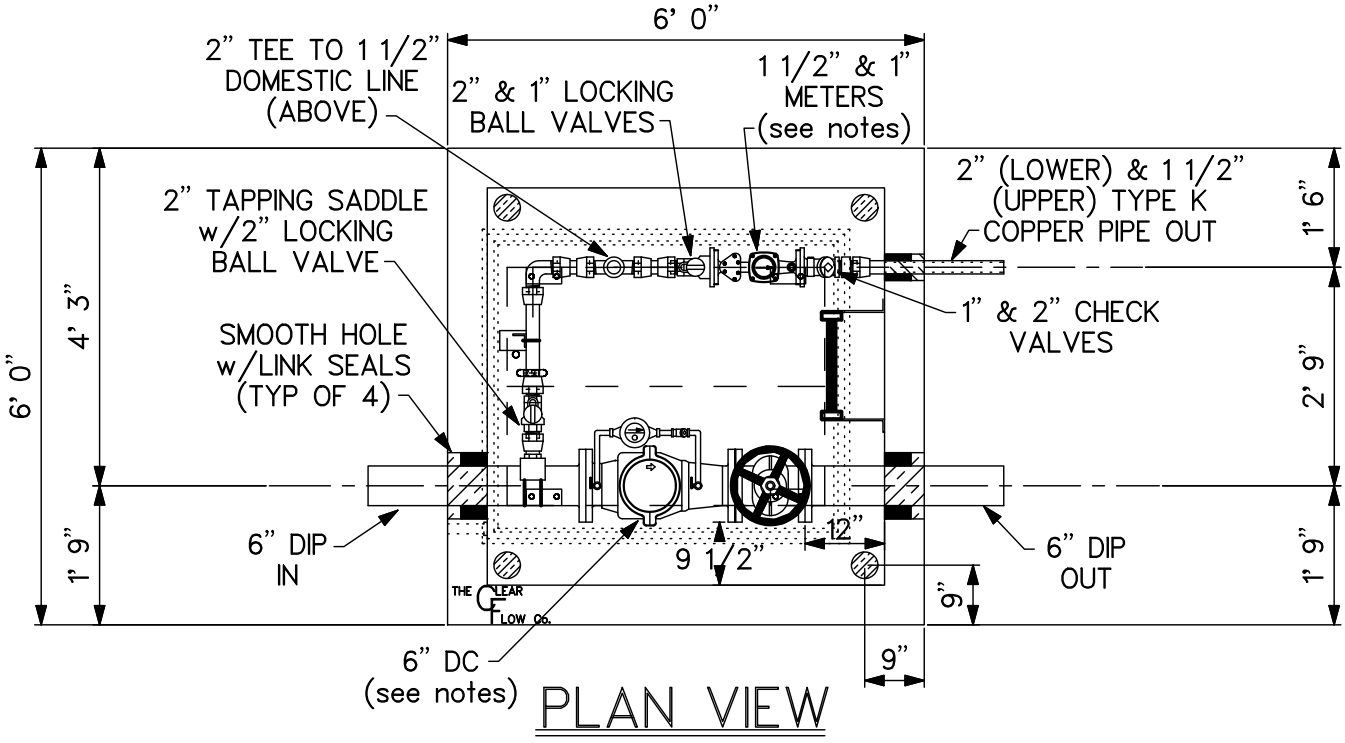

PLAN VIEW

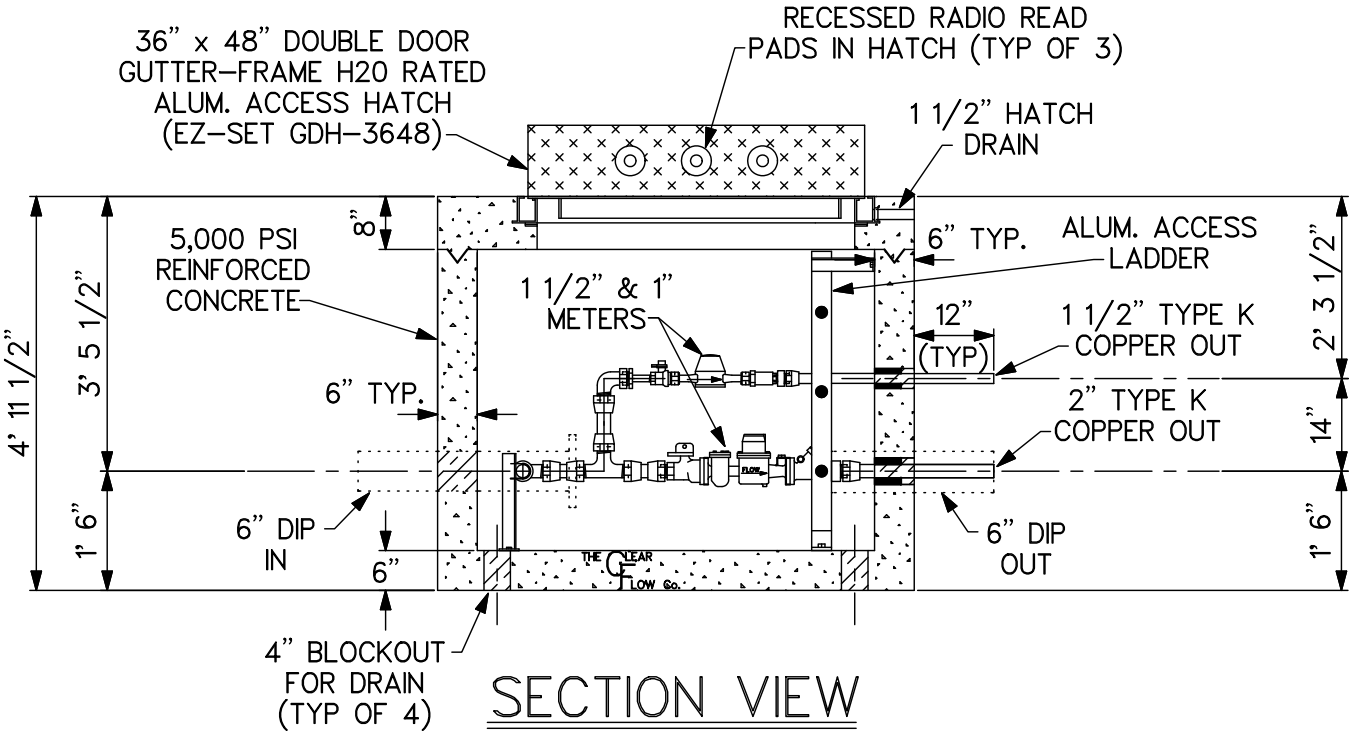

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 16,000 LBS.
2. 6" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/ONE OS&Y GATE VALVE
3. DOMESTIC LINES ARE TYPE K COPPER WITH GRIP JOINT FITTINGS, BALL VALVES ON INLETS (w/LOCKING TABS) & CHECK VALVE OUTLETS
4. METERS SUPPLIED BY WVWA TO CLEAR FLOW & INSTALLED ON OUR YARD.

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 1/19/11	DWG: WVWA DC6x1Hx1

WVWA 6" DC VAULT w/1 1/2" & 1" DOMESTIC METERS

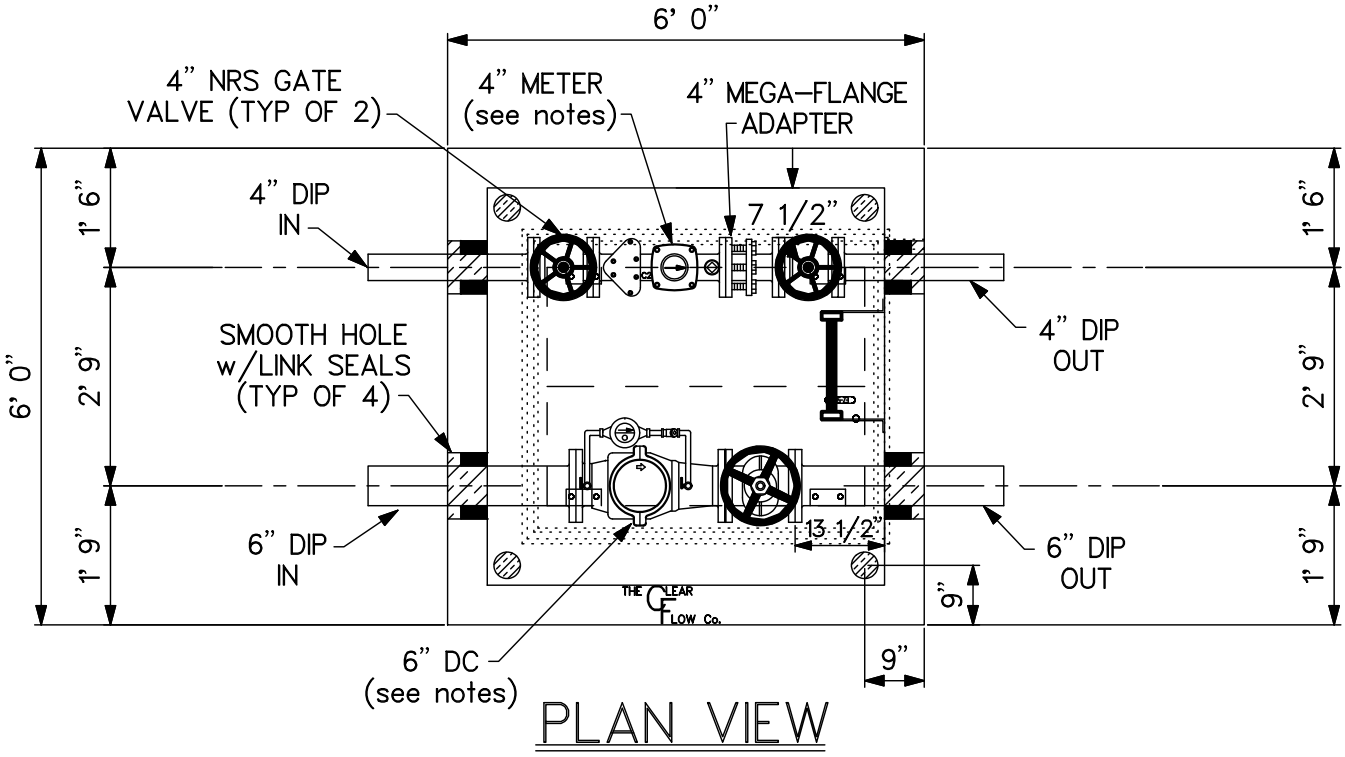

PLAN VIEW

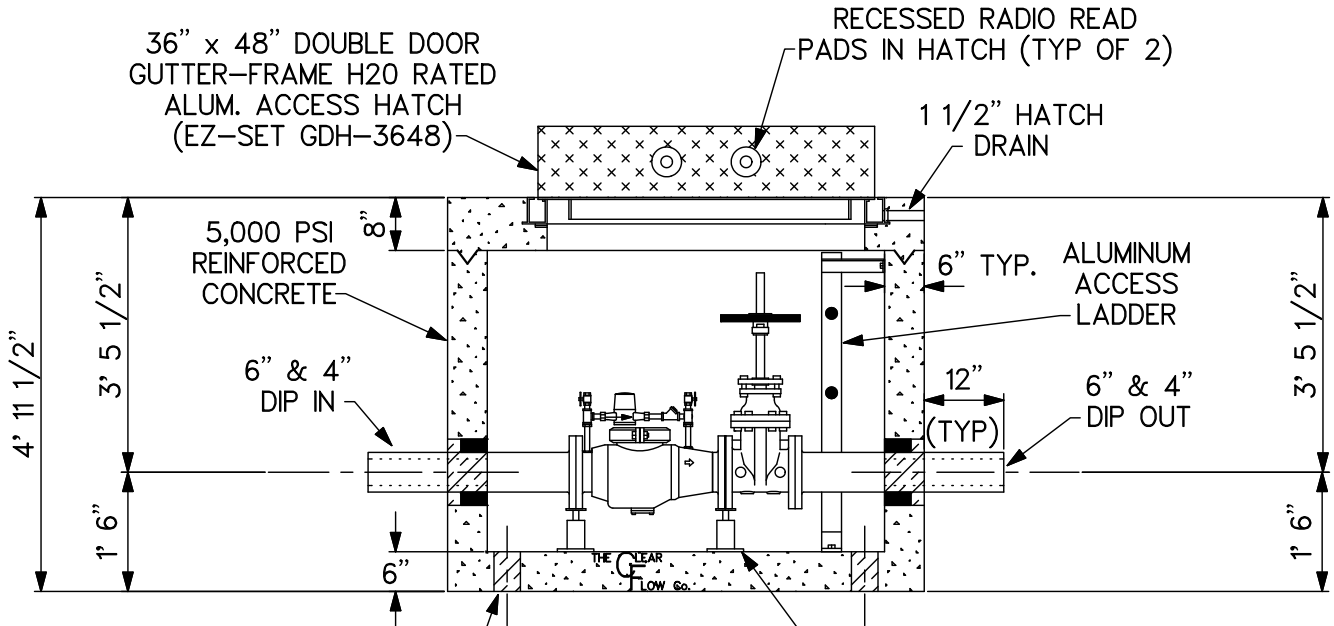

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 16,000 LBS.
2. 6" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/ONE OS&Y GATE VALVE
3. 4" METER SUPPLIED TO CLEAR FLOW BY THE WESTERN VA WATER AUTHORITY

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 3/19/12	DWG: WVWA DC6x4

WVWA 6" DC VAULT w/4" DOMESTIC METER

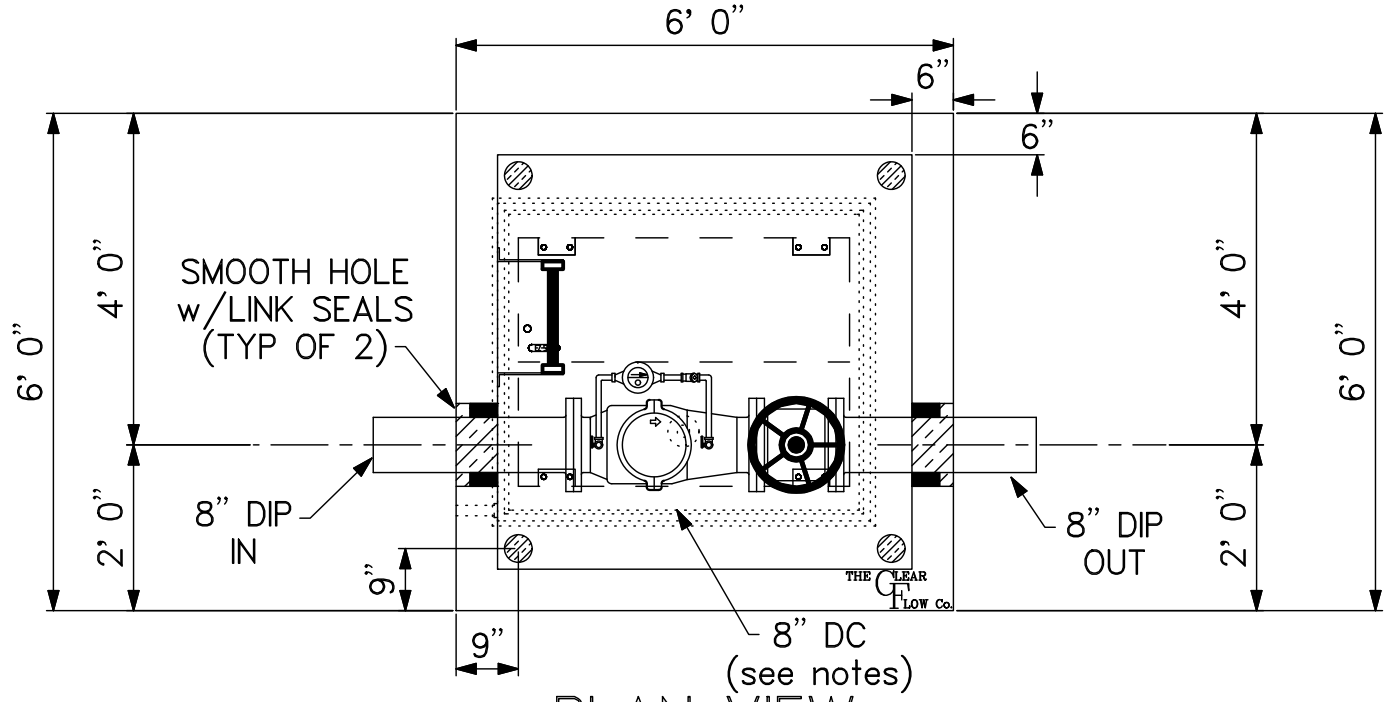

PLAN VIEW

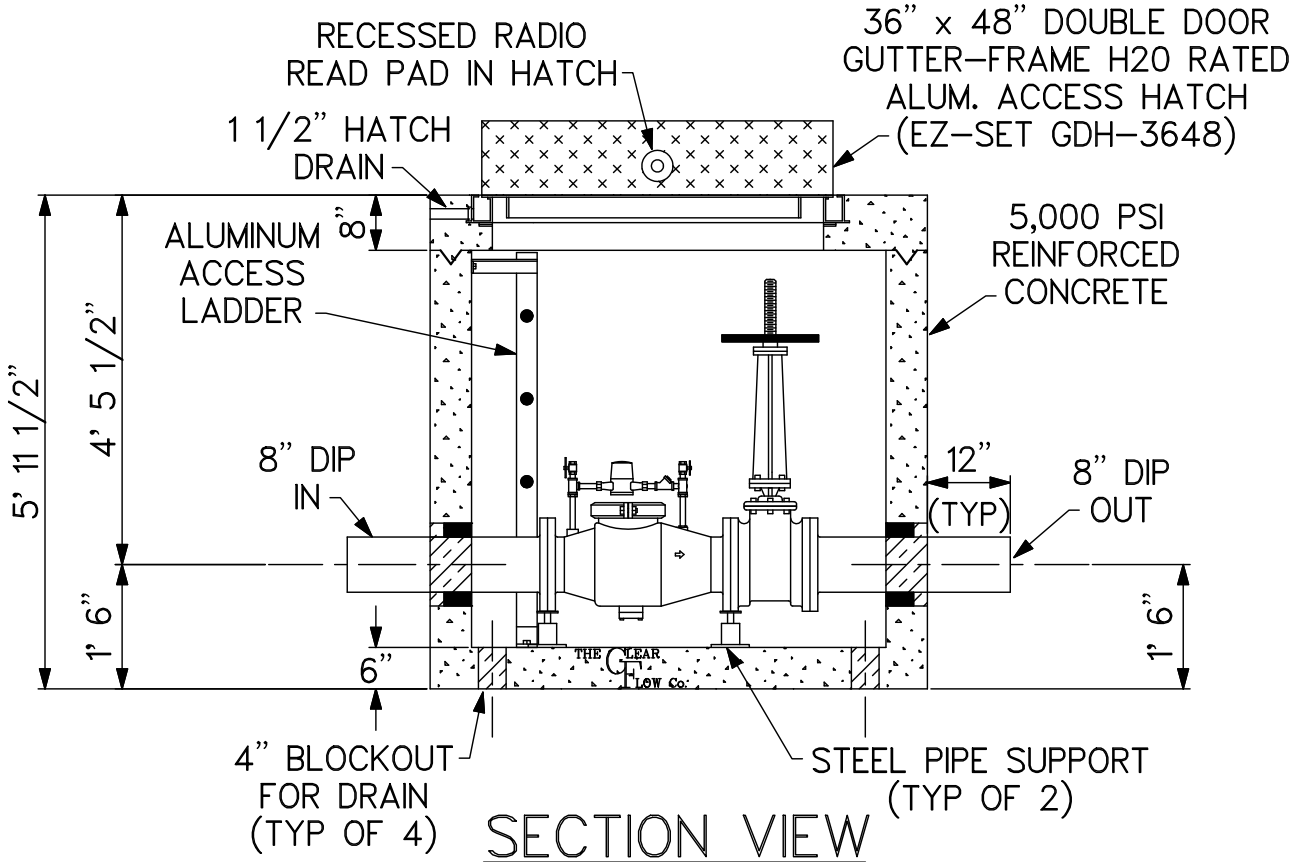

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 16,000 LBS.
2. 8" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/OS&Y GATE VALVE

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 9/28/12	DWG: WVWA DC8

WVWA 8" DETECTOR CHECK VAULT

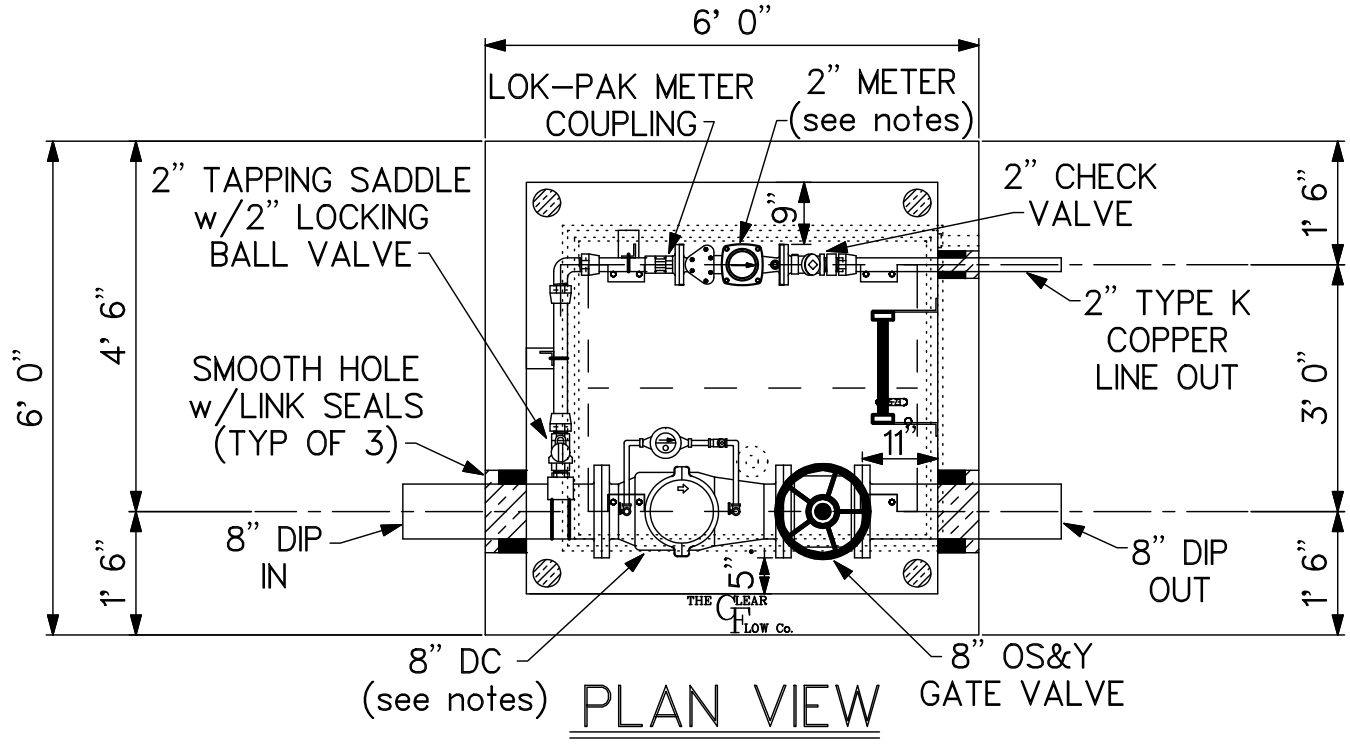

PLAN VIEW

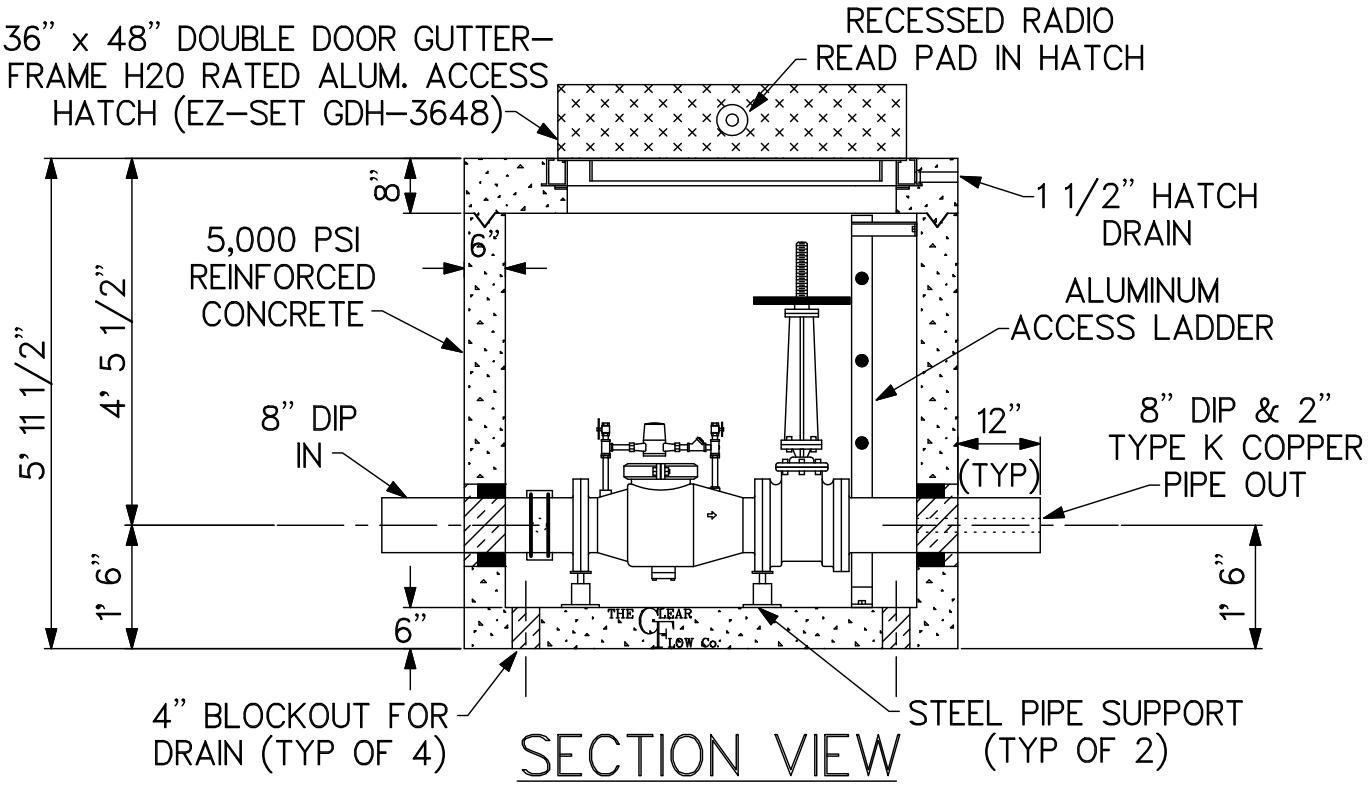

SECTION VIEW

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROX. 16,000 LBS.
2. 8" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/OS&Y GATE VALVE
3. 2" METER SUPPLIED TO CLEAR FLOW BY THE WESTERN VA WATER AUTHORITY

CLEAR FLOW
BY CP&P
CONCRETE PIPE & PRECAST, LLC
(800) 648 - 2678

SCALE: NONE	DATE: 9/28/12	DWG: WVWA DC8x2

WVWA 8" DC VAULT w/2" DOMESTIC METER